



# ENGINEERING STANDARDS & DRAWINGS

**2025 Edition**

**Planning Commission Recommendation: May 8, 2025**

**City Council Approval/Adoption: May 27, 2025**



G R E A T E R   S A L T   L A K E

**Municipal Services  
District**

860 W Levoy Drive, Suite #300  
Taylorsville, UT 84123  
**(385) 910-7027**  
**[msd.utah.gov/engineering](http://msd.utah.gov/engineering)**

## **GENERAL PROVISIONS**

**Magna City automatically adopts the latest revision of AASHTO “A Policy on Geometric Design of Highways and Streets” (Green Book), the Utah Manual on Uniform Traffic Control Devices (MUTCD), and APWA Manual of Standard Plans and Manual of Standard Specifications, with exceptions noted in this document.**

**The city engineer may approve exceptions to engineering standards and drawings where appropriate.**

# EXCEPTIONS TO APWA STANDARDS

<b>APWA Plan No./ Specification Section</b>	<b>Exception</b>
215, 216, 221.1, 221.2, 225, 229.1 & 229.2	APWA Plan No's. 221.1 and 221.2 are acceptable for use. APWA Plan No's. 215, 216, 225, 229.1, and 229.2 are not acceptable for use unless otherwise authorized by the MSD Engineer.
221.1, 221.2	When adverse slopes, right-of-way limitations, or existing obstructions occur, MSD Engineering may authorize deviations from the APWA apron/slope geometry.
251	Bituminous Concrete (asphalt) T-Patch thickness is 6" minimum for both residential and non-residential streets.
255	Bituminous Concrete (asphalt) T-Patch thickness is 6" minimum for both residential and non-residential streets.  2" mill and overlay are never required if there is a known upcoming city Capital Improvement Project has been designed and budgeted that will reconstruct or overlay the road within two (2) years. <ul style="list-style-type: none"> <li>• Full-width mill and overlay on roads newer than three (3) years.</li> <li>• APWA Mill and overlay required if street cut is longer than 300 feet long and pavement is 3-7 years old.</li> <li>• Mill and overlay not required if pavement is greater than 7 years old.</li> </ul> Mill and overlay must meet requirements in Magna City Code 14.16.010C.
292	Steel tube is to be 12' x 2" x 2". Standard Plan 140 in this book applies in locations where sign is installed in concrete.
315.1, 315.2 & 316	Where APWA inlet plans refer to frame and grate per APWA Plan No. 308, contractor shall use Standard Plan 201 in this book, unless otherwise authorized by the MSD Engineer.
332	The use of pre-cast "knock-out" boxes in storm drain facilities may be authorized by the MSD Engineer, upon written request and provided the following conditions are met: <ol style="list-style-type: none"> <li>a) All other requirements of APWA Plan 332 - Precast Box, are still met.</li> <li>b) Boxes shall have engineered design for AASHTO's HL-93 live load and shall be designed for lateral soil loads appropriate for the burial depth and conditions.</li> <li>c) The thickness of concrete collars where the pipe enters box at the knockout face shall extend 6" to 9" from the exterior face of the box and shall cover the entire side of the structure with no less than 12" concrete all the way around the pipe. Collars shall have a minimum of four (4) #4 dowels tying the collar to the precast box and include a #4 rebar ring or square tie around the pipe.</li> <li>d) Inspection and certification required on all precast boxes.</li> </ol>
381	(Note 2A) - Use granular backfill borrow for common fill.
382	(Note 2B) - Use granular backfill borrow for common fill. (Note 3A) - Minimum trench width is to be Pipe O.D. + 24" or (Pipe O.D. x 1.25)+12", whichever is greater.
33 05 02	Public storm drain pipes and culverts shall be 15" dia.or greater RCP unless otherwise authorized by the MSD Engineer. Installation must follow manufacturer's direction. Provide a minimum amount of 1' cover over top of concrete pipes and 2' cover over the top of pipes of other materials

	unless approved otherwise by manufacturer and MSD Engineer. Corrugated metal pipe and vitrified clay pipe are not allowed.
--	--

# STANDARD DETAILS TABLE OF CONTENTS

## SECTION 1 – ROADWAYS

### General

Legend and Symbols.....	100
Abbreviations.....	101

### Details

Roadway Section.....	110
Curb Ramps.....	135
Sign Post in Concrete.....	140
Sidewalk Obstruction Detail.....	150
Defective Concrete.....	155

### Street Light Details

Collector LED Street Light.....	161
Industrial LED Street Light.....	162
Residential LED Street Light.....	163
Arterial LED Street Light .....	164
Magna Main St Dual LED Street Light.....	165
Magna Main St Single LED Street Light with Banner Arms.....	166
Magna Main St Banner Pole.....	167

## SECTION 2 - STORM DRAIN FACILITIES

### Hardware

Curb Opening Frame and Grate.....	201
Ladder Rung.....	208

### Drainage Facility Guidelines

Detention Basin Guidelines.....	300
Outlet Structure Guidelines.....	301

SYMBOL LEGEND					
DESCRIPTION	EXIST.	PROP.	DESCRIPTION	EXIST.	PROP.
<b>SANITARY SEWER</b>					
CLEANOUT	◎	◎	IRRIGATION SHUT-OFF VALVE	IRR	IRR
SS MANHOLE	◎	◎	IRRIGATION CONTROL VALVE BOX	◎	◎
SS VALVE	☒	☒	IRRIGATION GATE	☒	☒
SS METER	☒	☒	<b>NATURAL GAS</b>		
SEWER STUB	◎	◎	GAS METER	◎	◎
<b>STORM DRAIN</b>					
CATCH BASIN	■	■	GAS VALVE	☒	☒
DRY WELL	DW	DW	GAS MANHOLE	◎	◎
SD CLEAN OUT BOX	□	□	<b>SITE</b>		
FLARE END	▽	▽	BOLLARD	■	■
<b>COMMUNICATION</b>			BOULDER	○	●
TELE. MANHOLE	○	○	DRINKING FOUNTAIN	■	■
TELE. PEDESTAL	○	○	FLAGPOLE	○	○
TELE. POLE	○	●	GATE	—	—
TV PEDESTAL	TV	TV	MAIL BOX	■	■
CABLE TV	○<-->	○<-->	PEDESTRIAN SIGNAL	↑↓	↑↓
<b>DOMESTIC WATER</b>			SCHOOL SIGN	—	—
FIRE HYDRANT	●	●	SIGN	—	—
SPIGOT	◎	●	SPOT ELEVATION	☒	☒
WATER MANHOLE	W	W	TREE (SHRUB)	○	○
WATER METER	●	●	TREE	○	○
WATER VALVE	☒	☒	TEST HOLE	TH	TH
YARD HYDRANT	●	●	WELL	W	W
<b>ELECTRIC</b>			WELL (MONITORING)	W	W
ELEC. MANHOLE	◎	◎	CONCRETE FLATWORK	—	—
ELEC. METER	■	■	ASPHALTIC CONCRETE	—	—
ELEC. TRANS.	■	■	<b>SURVEY</b>		
JUNCTION BOX	□	□	CAP	●	—
GUY WIRE	○	○	CTRL PT	○	—
POWER STUB	◎	◎			
POWER/UTILITY POLE	○	●			
STREET LIGHT	●	●			
STREET LIGHT WITH ARM	○	●			
TRAFFIC SIGNAL POLE	○	●			

LINE LEGEND		
DESCRIPTION	EXISTING	PROPOSED
STORM DRAIN	SD	SD
SANITARY SEWER	SS	SS
WATER	W	W
IRRIGATION	IRR	IRR
NATURAL GAS	G	G
OVERHEAD POWER	DHE	DHE
UNDERGROUND POWER	E	E
OVERHEAD TELEPHONE	DHT	DHT
UNDERGROUND TELEPHONE	T	T
FIBER OPTIC	FO	FO
CABLE TELEVISION	CTV	CTV
FENCE	□	□
MAJOR CONTOUR	—4520—	—4520—
MINOR CONTOUR	—	—
TOP OF BANK	TOB	TOB
TOE OF SLOPE	TOE	TOE
PROPERTY LINE	—	—
PROPERTY LINE (OPTIONAL)	P/L	P/L
RIGHT OF WAY	R/W	R/W
TEMPORARY EASEMENT	T/E	T/E
PERMANENT EASEMENT	P/E	P/E
ROAD CENTERLINE	—	—
ROAD ASPHALT	\\	\\
ROAD GRAVEL	EG	EG
CURB AND GUTTER	—	—
ATMS	ATMS	ATMS
SAWCUT	SAW	SAW
GRADING FILL LIMIT	FILL	FILL
GRADING CUT LIMIT	CUT	CUT
DITCH/SWALE FLOWLINE	....	....



## LEGEND AND SYMBOLS

STANDARD PLAN

100

SHEET 1 OF 1

## ABBREVIATIONS

ABBREV.	TERM
ALUM	ALUMINUM
APPROX.	APPROXIMATELY
ASSY	ASSEMBLY
∠	ANGLE
@	AT (MEASUREMENTS)
BC	BEGINNING OF CURVE
BFS	BEGIN FULL SUPER
BLDG	BUILDING
B.M.	BENCH MARK
BNC	BEGIN NORMAL CROWN
BNS	BEGIN NORMAL SHOULDER
BOA	BEGINNING OF ALIGNMENT
BP	BEGINNING OF PROFILE
BSC	BITUMINOUS SURFACE COURSE
BSW	BACK OF SIDEWALK
BVC	BEGIN VERTICAL CURVE
BVCE	BVC ELEVATION
BVCS	BVC STATION
B.W.	BOTH WAYS
C	CHANNEL (STRUCTURAL)
CJ	CONTROL JOINT
CL or CL	CENTER LINE
CLR	CLEARANCE
CMP	CORRUGATED METAL PIPE
CO	CLEANOUT
CONC	CONCRETE
CONT	CONTINUOUS
CPLG	COUPLING
CTR	CENTER
CU FT	CUBIC FEET
CU YD	CUBIC YARD
DEG OR °	DEGREE
DET	DETAIL
DIA OR Ø	DIAMETER
D.I.P.	DUCTILE IRON PIPE
DIST	DISTRIBUTION
DWG	DRAWING
EA	EACH
EC	END OF CURVE
EFS	END FULL SUPER
ELB	ELBOW
ELEV OR EL.	ELEVATION
ENC	END NORMAL CROWN
ENS	END NORMAL SHOULDER
EOA	END OF ALIGNMENT
EP	END OF ALIGNMENT
E.W.	EACH WAY
EXIST	EXISTING
EVC	END VERTICAL CURVE
EVCE	EVC ELEVATION
EVCS	EVC STATION

## ABBREVIATIONS

ABBREV.	TERM
FF	FINISH FLOOR
FG	FINISH GRADE
FH	FIRE HYDRANT
FL	FLOW LINE
FLG	FLANGE
FT OR '	FEET
FTG	FOOTING
GALV	GALVANIZED
GB	GRADE BREAK
GV	GATE VALVE
HORIZ	HORIZONTAL
HP	HIGH POINT
ID	INSIDE DIAMETER
IE	INVERT ELEVATION
IN. OR "	INCH
INV.	INVERT
K	CURVE COEFFICIENT
L	LEFT
LB	LINE BEGINNING
LB OR #	POUND
LF	LINEAL FEET
LN	LINEAL
LP	LOW POINT
MAX	MAXIMUM
MIN	MINIMUM
NO. OR #	NUMBER
O.C.	ON CENTER
OVERALL HP	OVERALL HIGH POINT
OVERALL LP	OVERALL LOW POINT
PC	POINT OF CURVATURE
PCC	POINT OF COMPOUND CURVATURE
PE	POLYETHYLENE
PI	TANGENT-TANGENT INTERSECT
PL OR ℗	PLATE OR PROPERTY LINE
PRC	POINT OF REVERSE CURVATURE
PT	END OF CURVE
PVC	POLYVINYL-CHLORIDE
PVI	POINT OF VERTICAL INTERSECTION
R	RADIUS OR RIGHT
R&R	REMOVE & REPLACE
RC	REVERSE CROWN
RCP	REINFORCED CONCRETE PIPE
REM	REMOVE
REQ'D	REQUIRED
REV	REVISION
R/W OR ROW	RIGHT-OF-WAY
S	SLOPE

## ABBREVIATIONS

ABBREV.	TERM
SBO	SHOULDER BREAKOVER
SPEC	SPECIFICATION
STA	STATION
STD	STANDARD
STL	STEEL
ST STL	STAINLESS STEEL
TBC	TOP BACK OF CURB
TFC	TOP FACE OF CONCRETE
TOB	TOP OF BANK
TOC	TOP OF CONCRETE
TOF	TOP OF FOOTING
TOP	TOP OF PIPE
TOW	TOP OF WALL
TYP	TYPICAL
U.N.O.	UNLESS NOTED OTHERWISE
VCC	VERTICAL COMPOUND CURVE
VCCE	VCC ELEVATION
VCCS	VCC STATION
VRC	VERTICAL REVERSE CURVE
VRCE	VRC ELEVATION
VRCS	VRC STATION
W/	WITH
W/O	WITHOUT
W/REQ'D	WHERE REQUIRED



## ABBREVIATIONS

STANDARD PLAN  
101  
SHEET 1 OF 1

## NOTES:

Materials, construction, and workmanship shall be in accordance with the current edition of "APWA Manual of Standard Specifications" addendums, and modifications thereto; and as directed by the MSD Public Works Engineer. Reference to specific sections of APWA does not limit requirements to that section.

**SUBGRADE:** See APWA Section 32 05 10 (Backfilling Roadways) for preparation and proof rolling of roadway, curb and gutter, and sidewalk.

**UNTREATED BASE COURSE:** Shall be Grade 1 as per APWA Section 32 11 23 (Aggregate Base Course). Place fill in no greater than 6 inch lifts after compaction as per APWA Section 32 05 10 (Backfilling Roadways). Compact to no less than 95% relative density based on the Modified Proctor Density as per APWA Section 31 23 26 (Compaction).

**PRIME COAT:** Prime coat, as directed by the engineer, on untreated base course before placing asphalt. See APWA Section 32 12 13.19 (Prime Coat).

**TACK COAT:** Grade SS-1, CSS-1, or CSS-1h emulsified asphalt shall be applied to existing asphalt concrete or portland cement concrete surfaces prior to placing asphalt concrete pavement as per APWA Section 32 12 13.13 (Tack Coat).

**ASPHALT CONCRETE:** Unless otherwise approved in writing by the MSD Public Works Engineer or their designated representative, all roads shall be considered Road Class III and the bituminous concrete mix designator used shall correspond to the table on Sheet 2. Minimum allowed roadway section – 3 inches asphalt concrete on 8 inches untreated base course. Thicker sections required for collectors, minor arterials, and roadways with heavy truck traffic. Construct road mix bituminous surface course only when air temperature in the shade and road bed temperature are greater than 50 degrees.




## ROADWAY SECTION


STANDARD PLAN

110

SHEET 1 OF 2

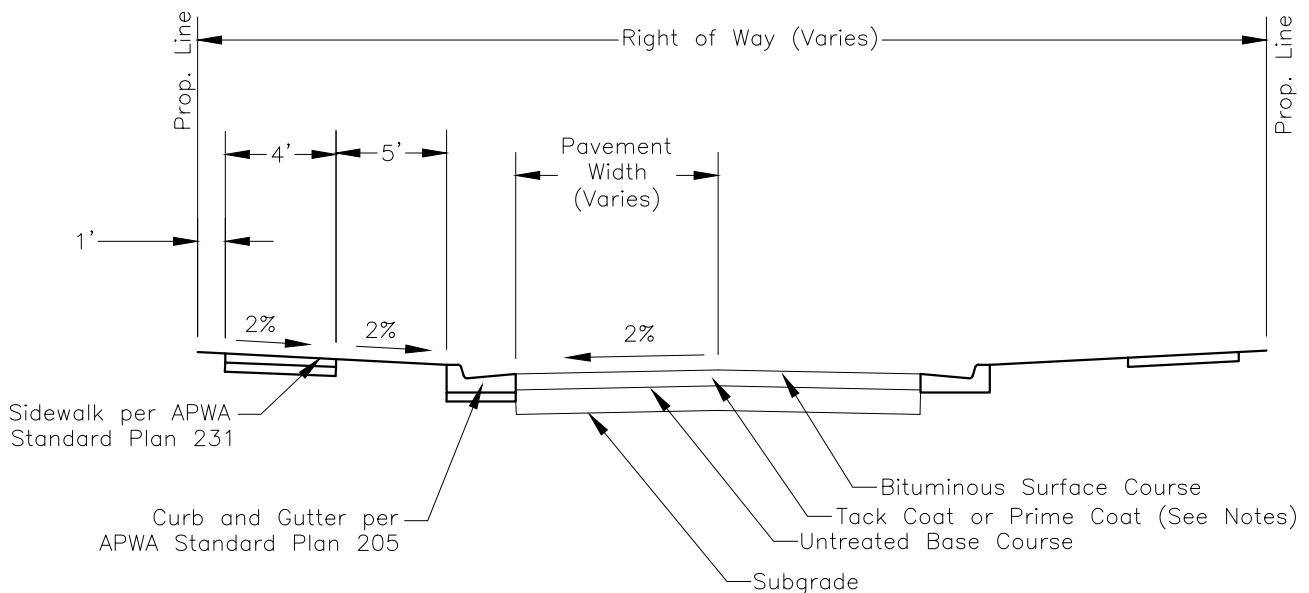

## STANDARD CONFIGURATION

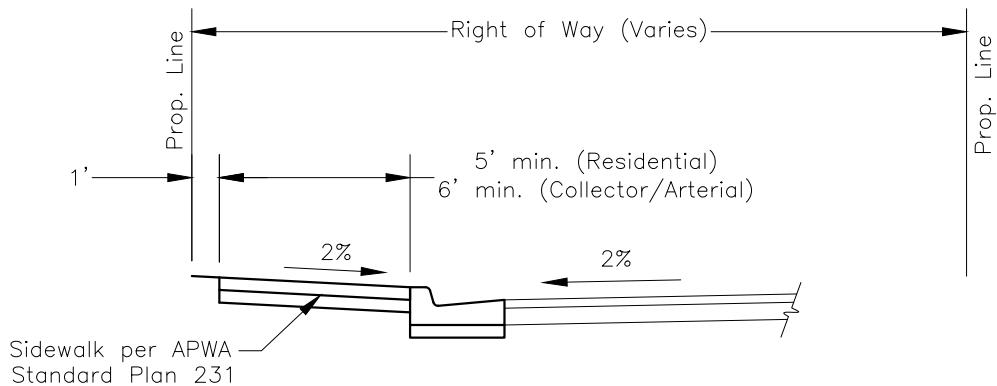

## CONTIGUOUS SIDEWALK

BITUMINOUS CONCRETE MIX DESIGNATOR BY ROADWAY CLASSIFICATION	
ROADWAY CLASSIFICATIONS*	BITUMINOUS CONCRETE MIX DESIGN**
Local/Private – Collector (60')	PG58-28, DM-1/2, 50 Blow
Collector (80') – Arterial (106')	PG64-34, DM-1/2, 50 Blow
Canyon Roads Cat. 2-6	PG58-28, DM-1/2, 50 Blow
Canyon Roads Cat. 1	PG64-34, DM-1/2, 50 Blow

\* See Section 14.12.100 of the municipal code for details.

\*\* See APWA 32 12 05.



## ROADWAY SECTION

## NOTES:

These Standard Drawings are intended to supplement all ADA and APWA guidelines and requirements. These drawings are for clarification, but do not alter, reduce or override any Federal ADA requirements.

Materials, construction, and workmanship shall be in accordance with the current edition of "APWA Manual of Standard Specifications" addendums, and modifications thereto; and as directed by the MSD Engineer. Reference to specific sections of APWA does not limit requirements to that section.

**SUBGRADE:** See APWA Section 32 05 10 (Backfilling Roadways) for preparation and proof rolling of roadway, curb and gutter, and sidewalk.

**UNTREATED BASE COURSE:** Shall be Grade 1 as per APWA Section 32 11 23 (Crushed Aggregate Base). Place fill in no greater than 6 inch lifts as per APWA Section 32 05 10 (Backfilling Roadways). Compact to no less than 95% relative density based on the Modified Proctor Density as required in APWA Section 31 23 26 (Compaction).

**CONCRETE:** Concrete shall be Class 4000 as per APWA 03 30 04 (Concrete).

**EXPANSION JOINT:** Expansion joint shall be 1/2" thick preformed expansion joint filler F1-bituminous mastic as per APWA Section 32 13 73 (Concrete Paving Joint Sealants) at each interface as shown.

**DETECTABLE WARNINGS:** Locate raised truncated domes so that the edge nearest the curb line is within 6 to 8 inches from the curb line excluding Curb Ramp Types H, and I where  $X < 5$  feet (see sheet 6 of 6). Provide 2-foot of truncated dome pattern at the lower end of all curb ramps extending the full width of the curb ramp. See typical dimensions on Type B Curb Ramp. Detectable warnings shall contrast visually with adjoining surfaces, either light-on-dark, or dark-on-light. Glued or surface applied domes are not acceptable for new construction. Stamped domes are not allowed under any conditions. Truncated dome materials shall be selected from the MSD approved materials list.

**RAMPS:** Length of any ramp not to exceed 15 feet. Ramp shown are examples only, site specific ramps may require modification and additional features to comply with current Federal ADA Guidelines.




## CURB RAMPS


STANDARD PLAN

135


SHEET 1 OF 6

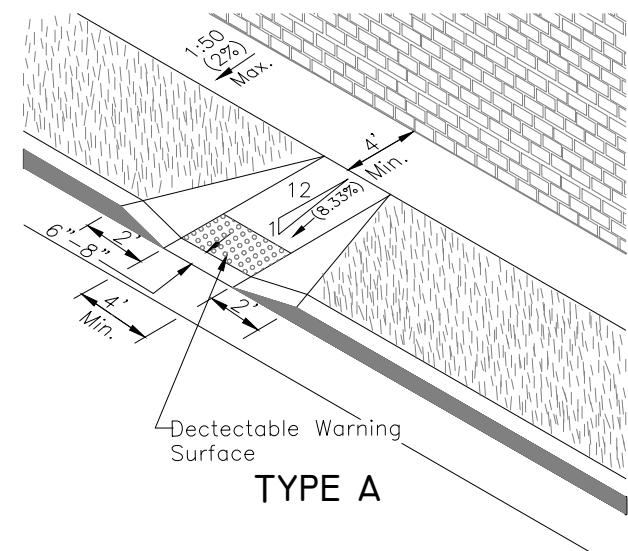


**TYPE A**

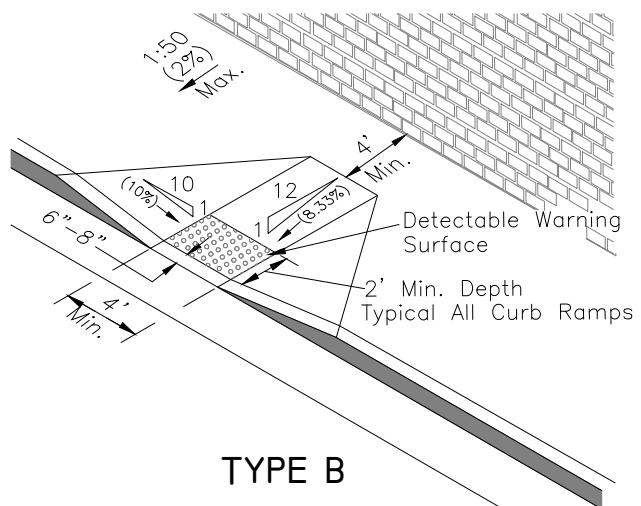


**TYPE B**

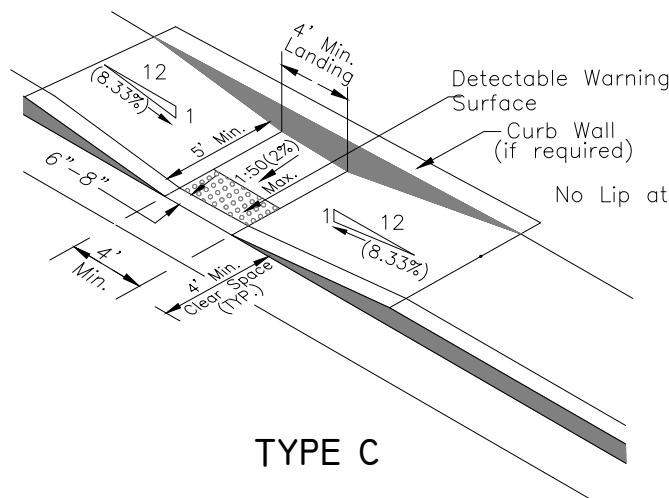

**TYPE C**

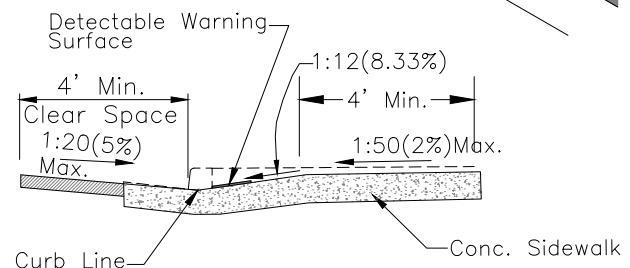

**SECTION TYPE A & B**

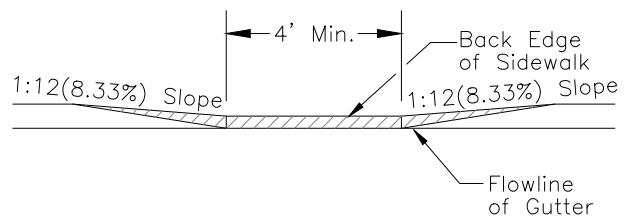

**ELEVATION TYPE C**

## NOTES:

1. **TYPE A**  
The entire ramp slope is achieved outside the sidewalk section. A concrete warped curb section shall begin 2' from edge of detectable warning surface.
2. **TYPE B**  
Provide at least 4' of sidewalk width beyond the ramp.
3. **TYPE C**  
Use this type of ramp when there is insufficient width to accommodate TYPE B curb ramp.
4. No pull box, utility vault, utility pole, manhole or similar appurtenance shall be located within the sidewalk ramp area.
5. It is desirable to locate all drain inlets out of sidewalk ramp area. Use of drain inlet within ramp area requires special design of inlets.
6. See Detail 'A' (sheet 4 of 6) for raised truncated dome detail on detectable warning surface.
7. Maximum cross slope of adjoining gutters and road surface immediately adjacent to the curb ramp, or accessible route, shall not exceed 1:20 (5%).
8. Running and cross slope at midblock crossings shall be permitted to be warped to meet street or highway grade.





## CURB RAMPS

STANDARD PLAN

135

SHEET 2 OF 6

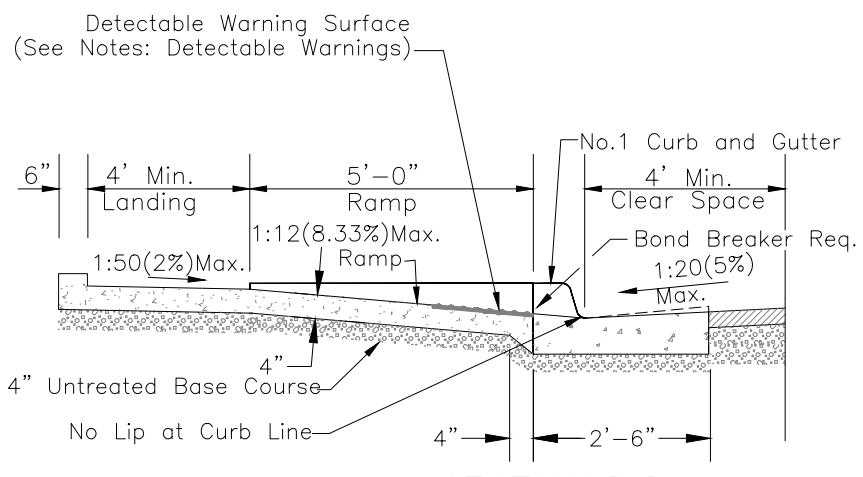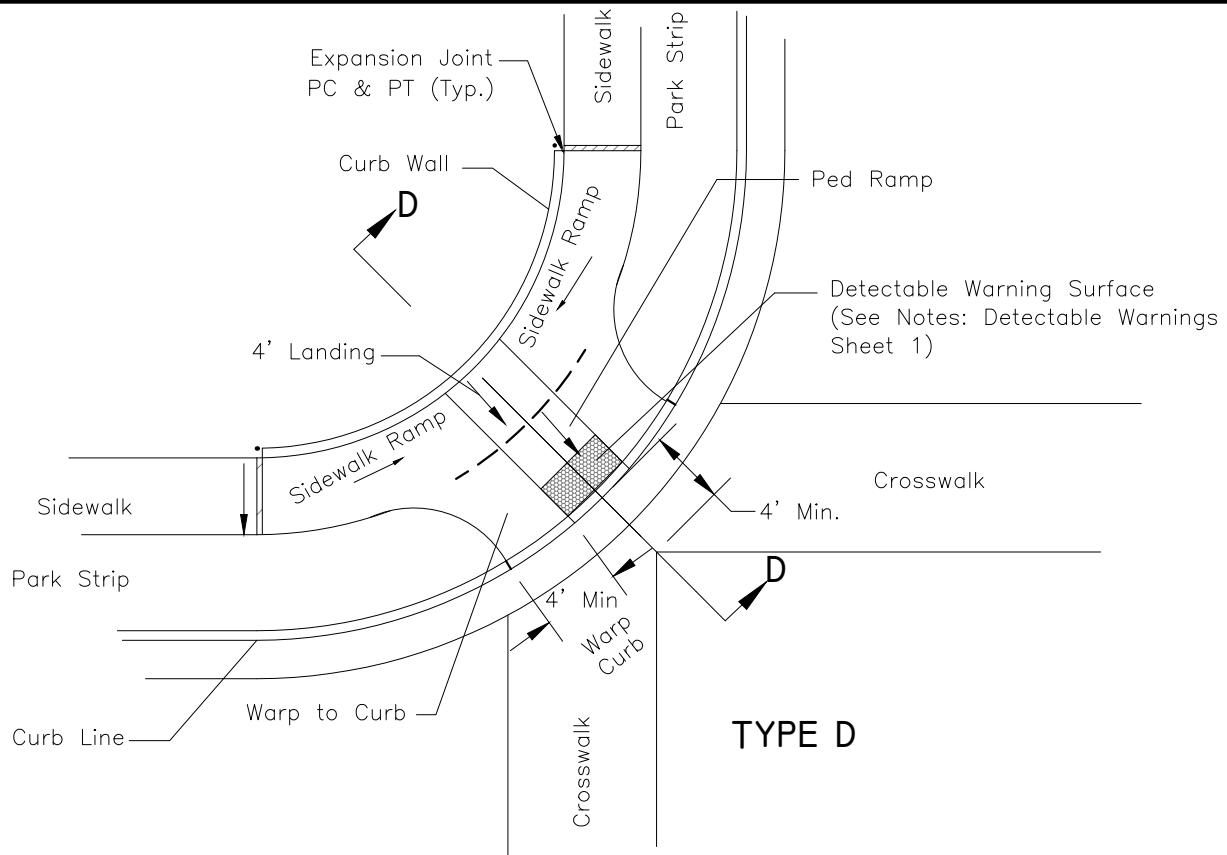

## NOTES:

Landing: Cross Slope: 1:50(2%) Max. Towards The Street.

Ped Ramp Slope: 1:12(8.3%) Max.

Sidewalk Ramp: 1" Rise Required Length May Vary  
Slope May Vary, But 1:12(8.3%) Max.

Sidewalk: Cross Slope 1:50(2%) Max. Towards  
The Street.

Curb Wall: 6" Wide As Needed.




## CURB RAMPS


STANDARD PLAN

135


SHEET 3 OF 6

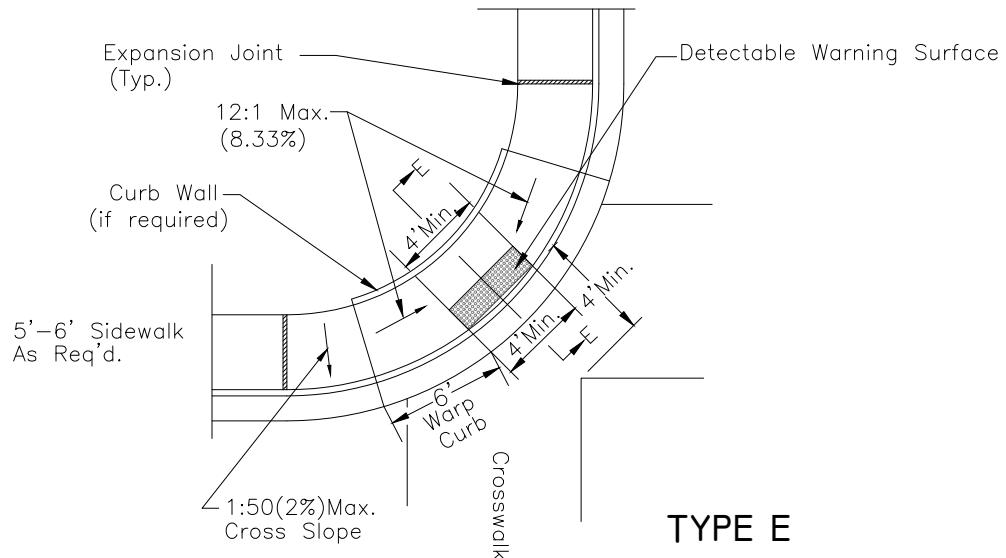

TYPE E

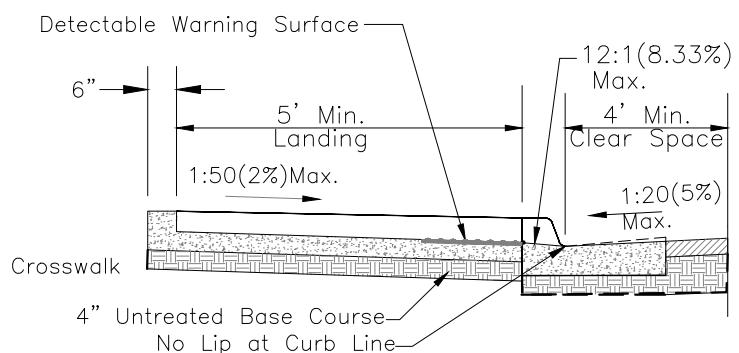

SECTION E-E

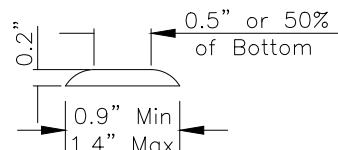

Raised Truncated Domes  
of Detectable Warning Surface

DETAIL 'A'





CURB RAMPS

STANDARD PLAN

135

SHEET 4 OF 6

1:50(2%)Max.  
Cross Slope

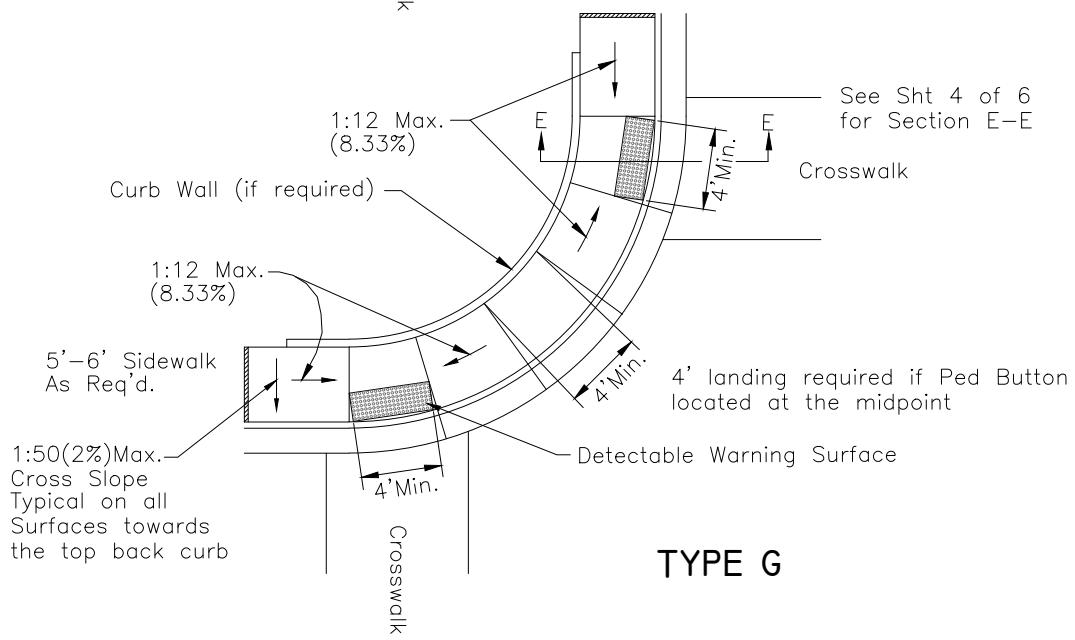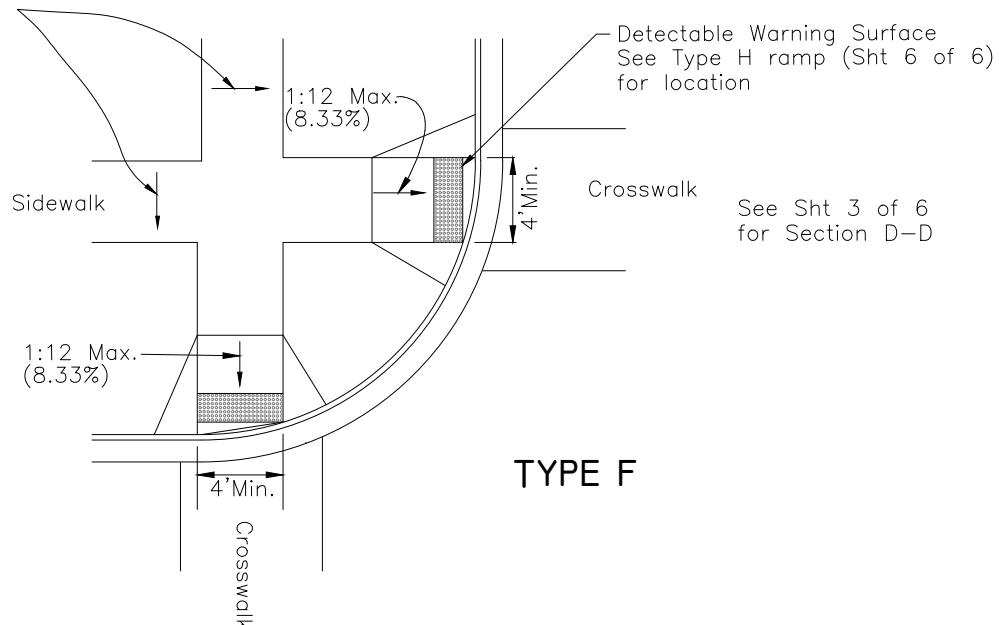

## NOTES:

1. Provide detectable warning surface for full width of ramp, min. 4' width.
2. Detectable warning surface is required wherever curb is absent.
3. When detectable warning surface is cut, grind remaining portion of any cut domes. Seal all cut panel edges to prevent water damage.
4. Locate curb cut within crosswalk.




## CURB RAMPS


STANDARD PLAN

135

SHEET 5 OF 6

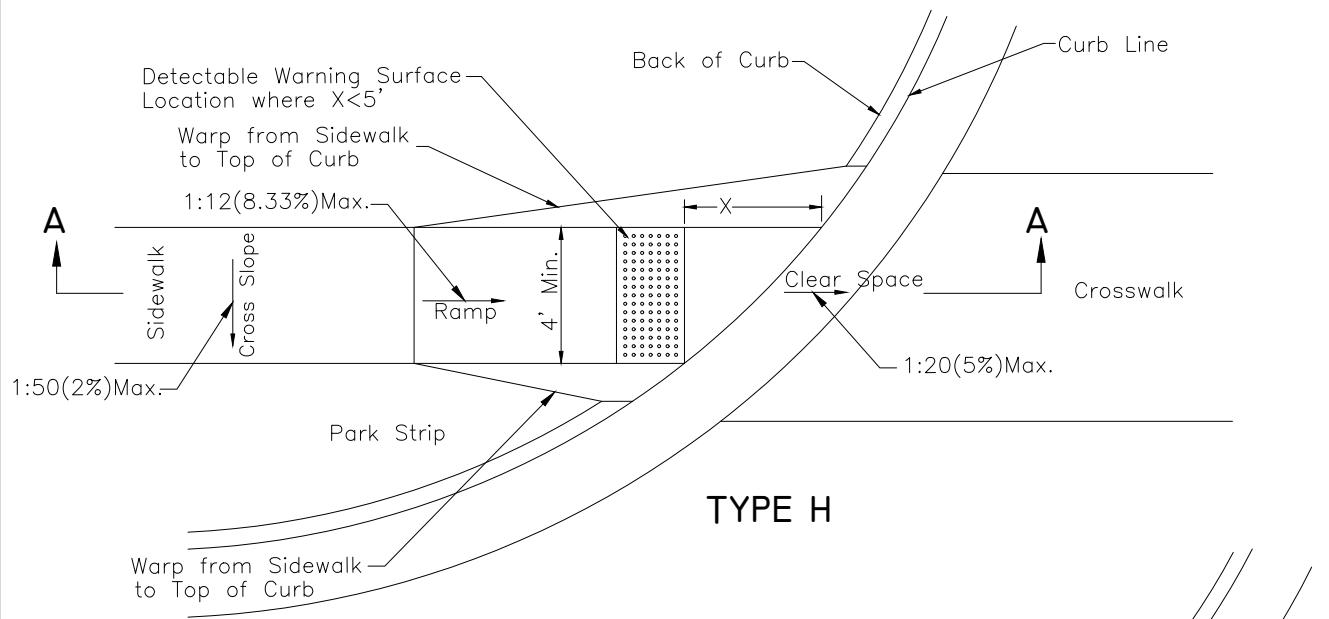


TYPE H

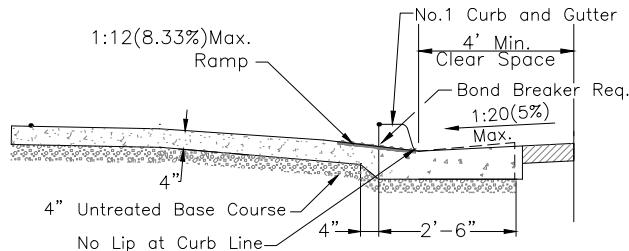

SECTION A-A

REQUIRED DETECTABLE WARNING SURFACE  
LOCATION WHERE  $X > 5'$  FOR TYPE H & TYPE J

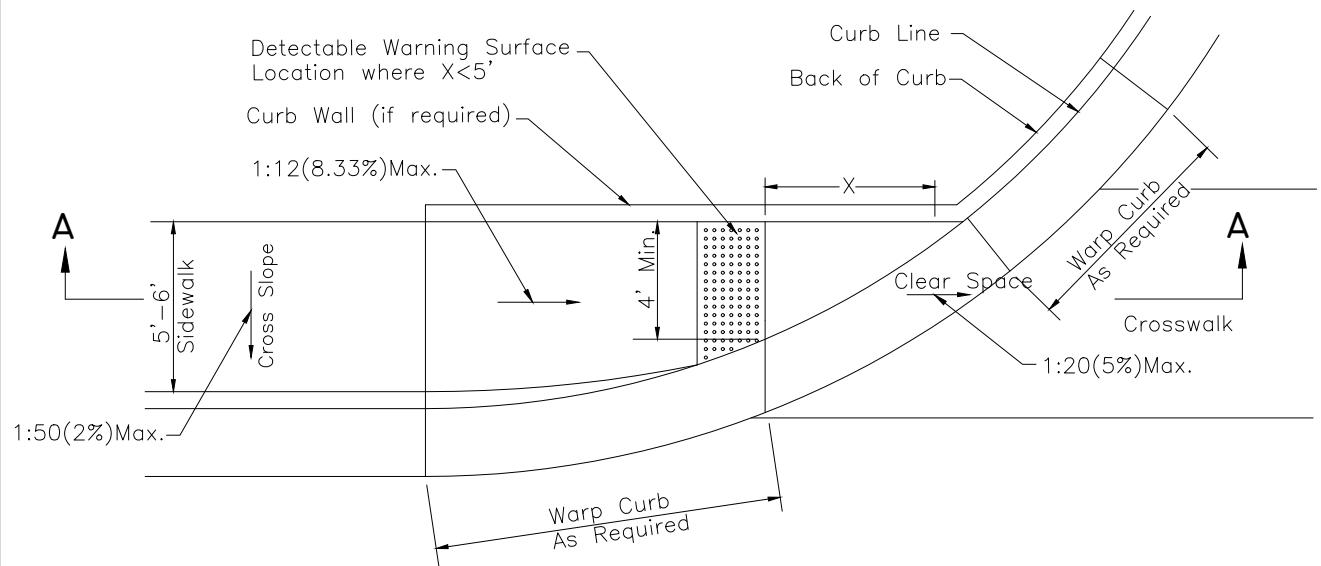

TYPE J



## NOTES:

1. Get ENGINEER's approval of sign format and installation.
2. Bolts, Nuts, Washers, Accessories: Stainless or galvanized steel, APWA Section 05 05 23.
3. Install sign posts on corner selected by ENGINEER.
4. Install the edge of the sign 2 feet from the vertical extension of the back of curb as near as possible to the approach curb P.C. (point of curvature).




## SIGN POST IN CONCRETE DETAIL

STANDARD PLAN

140

SHEET 1 OF 2

REV. 2025-0

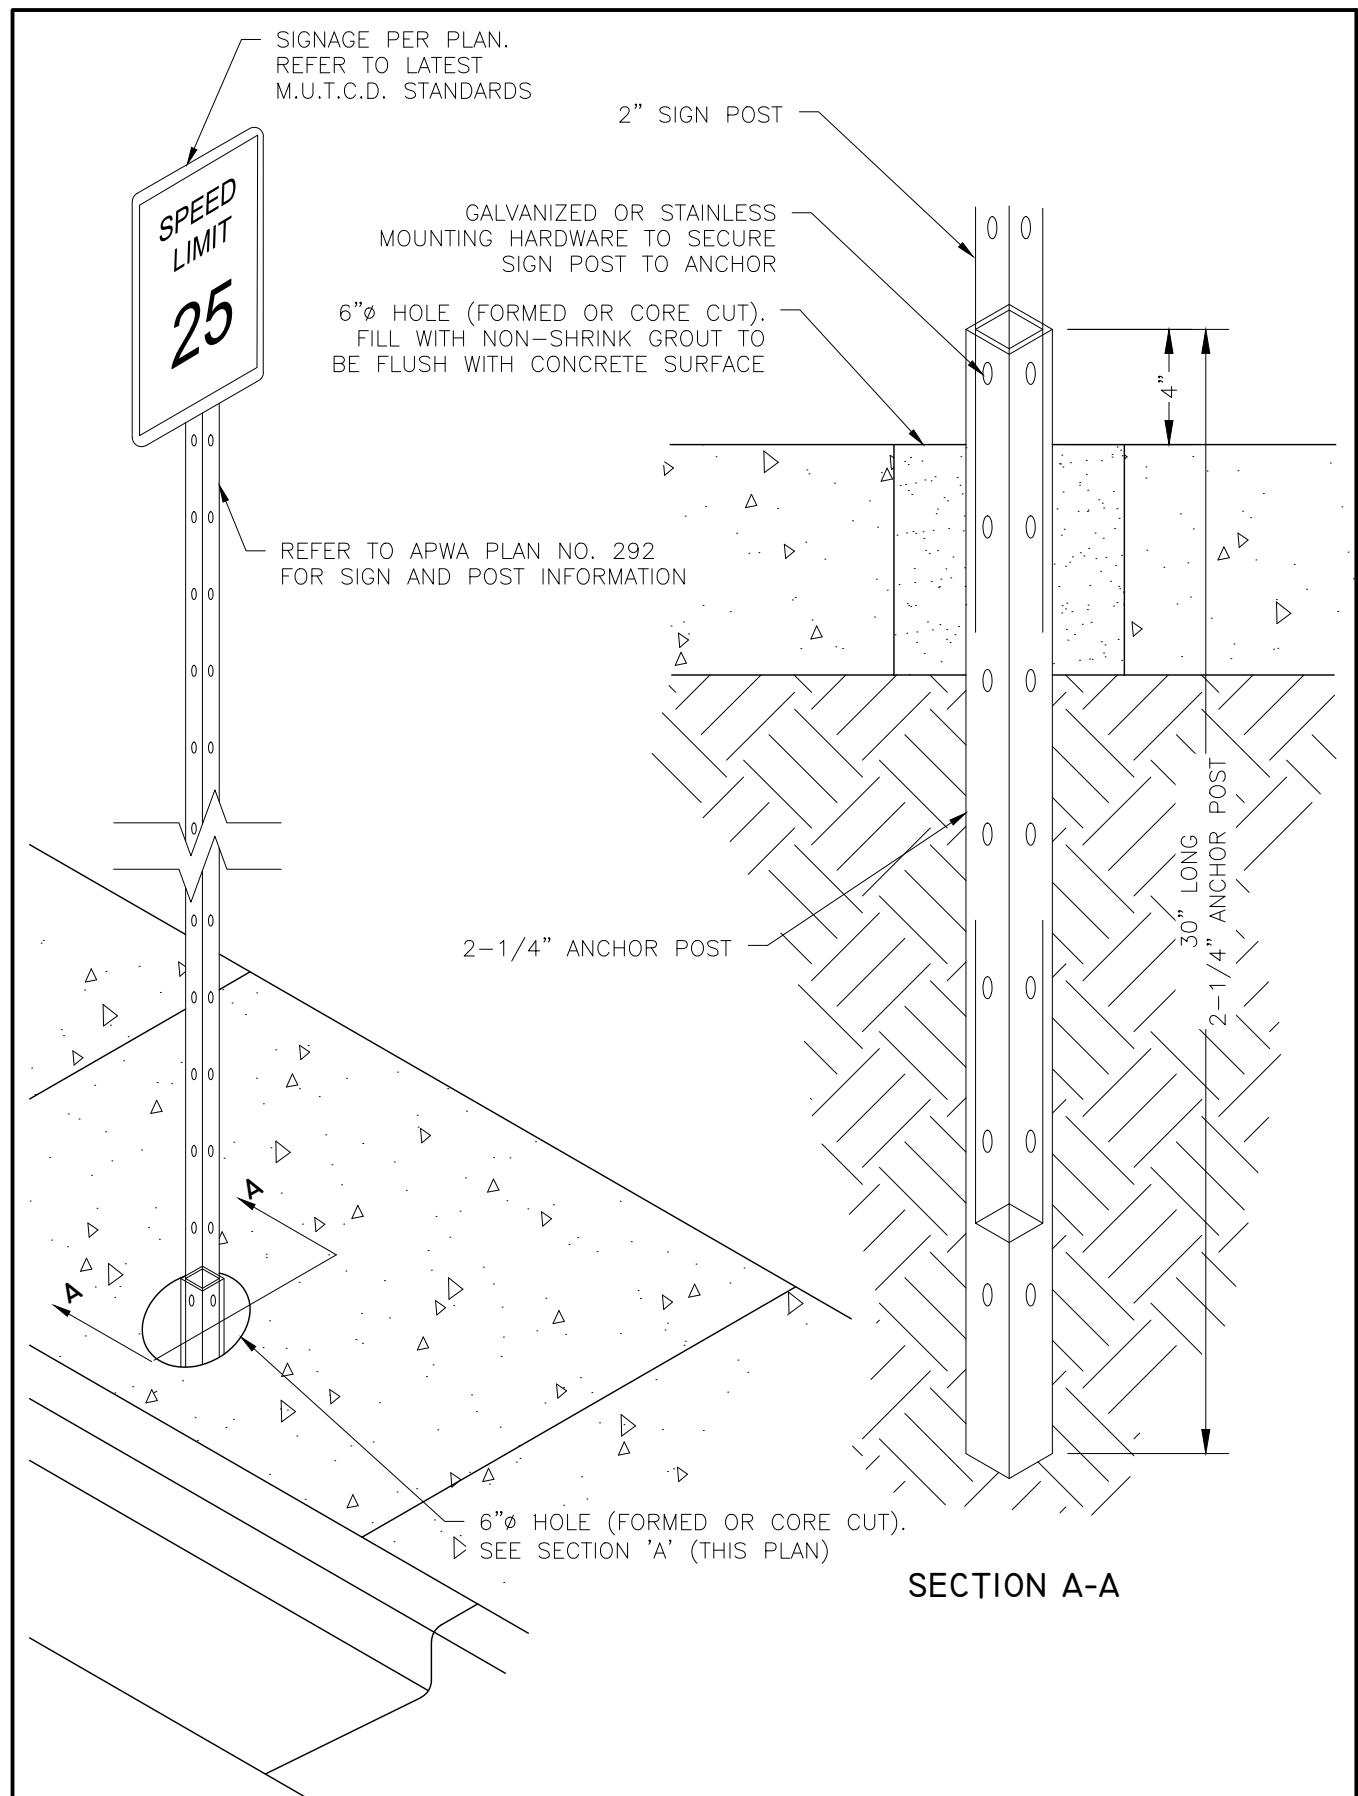

## SIGN POST IN CONCRETE DETAIL


STANDARD PLAN

140

SHEET 2 OF 2

## NOTES:

1. This detail has been developed to provide a location for utilities when sidewalk is placed contiguous with curb and gutter.
2. Minimum sidewalk clear width adjacent to obstruction shall be 4' unless otherwise approved by the MSD Engineer. Verify with the engineer that the appropriate right-of-way width exists where sidewalk must be widened around an obstruction.
3. Brick-stamped and colored concrete areas shall match the thickness of concrete and base course of the adjacent sidewalk.

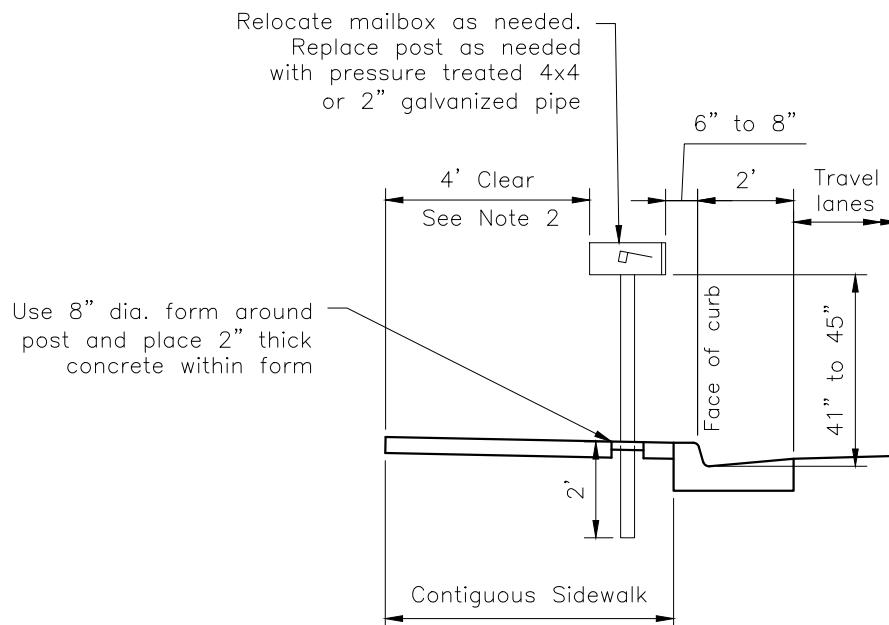

MAILBOX RELOCATION






## SIDEWALK OBSTRUCTION DETAIL

STANDARD PLAN

150

SHEET 1 OF 2

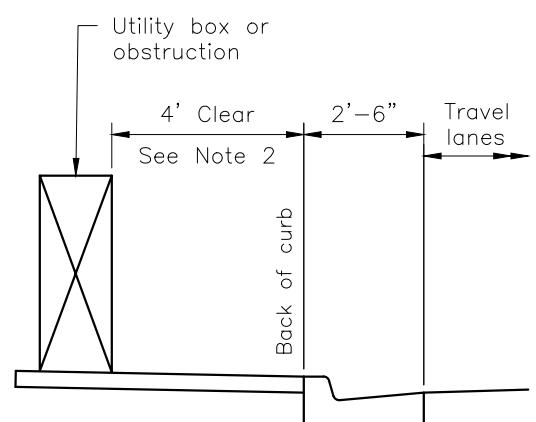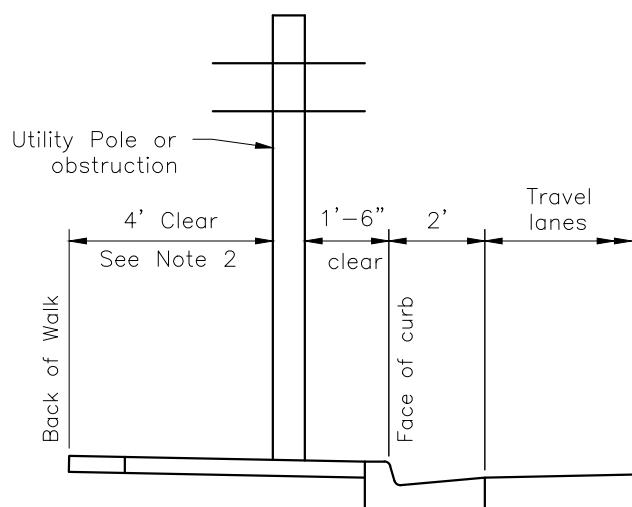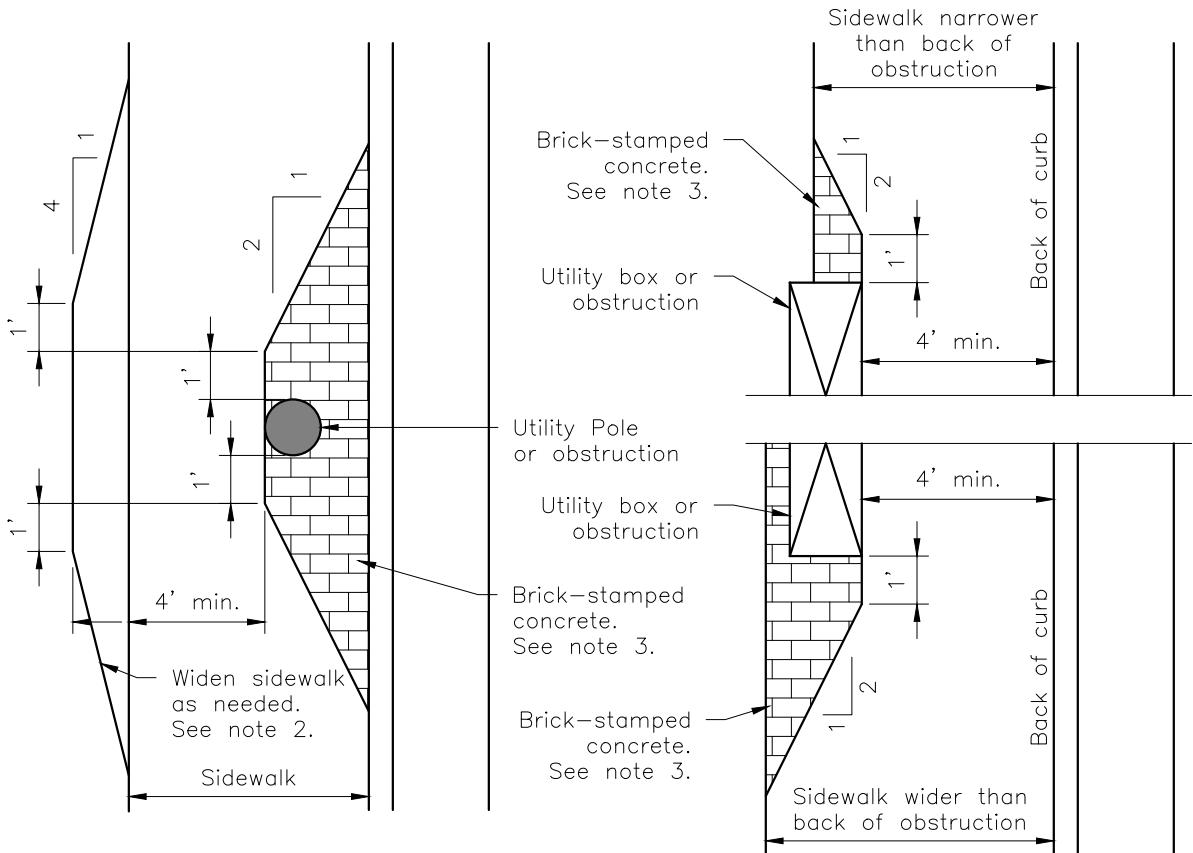

CURB-SIDE OBSTRUCTION

BACK-OF-WALK OBSTRUCTION



SIDEWALK OBSTRUCTION  
DETAIL

STANDARD PLAN  
150  
SHEET 2 OF 2

## NOTES:

1. Concrete is considered defective if any component has one or more of the conditions shown on sheet 2. The MSD may require section replacement for any latent defects not described.
2. Defective concrete resulting from an individual crack is defined as having at least one of the following:
  - horizontal separation wide enough to insert a dime
  - vertical displacement resulting from crack
  - spalling, spidering, or chipping of crack
3. Defective concrete resulting from multiple cracks is defined as having at least one of the following:
  - one section with multiple cracks where both ends of crack link with slab edge, joint, or another crack.
  - adjacent sections with one or more cracks where both ends of crack link with slab edge, joint, or another crack.
4. Defective concrete resulting from vertical displacement is defined as one of the following:
  - at time of performance bond release: any vertical displacement at construction joint or expansion joint.
  - concrete not under warranty: vertical displacement at construction joint or expansion joint greater than  $\frac{1}{4}$ ".
5. Defective concrete resulting from spalls is defined as one of the following:
  - at time of performance bond release: any spalling.
  - concrete not under warranty: spalling covering more than 20% of a section.




## DEFECTIVE CONCRETE

STANDARD PLAN

155

SHEET 1 OF 2

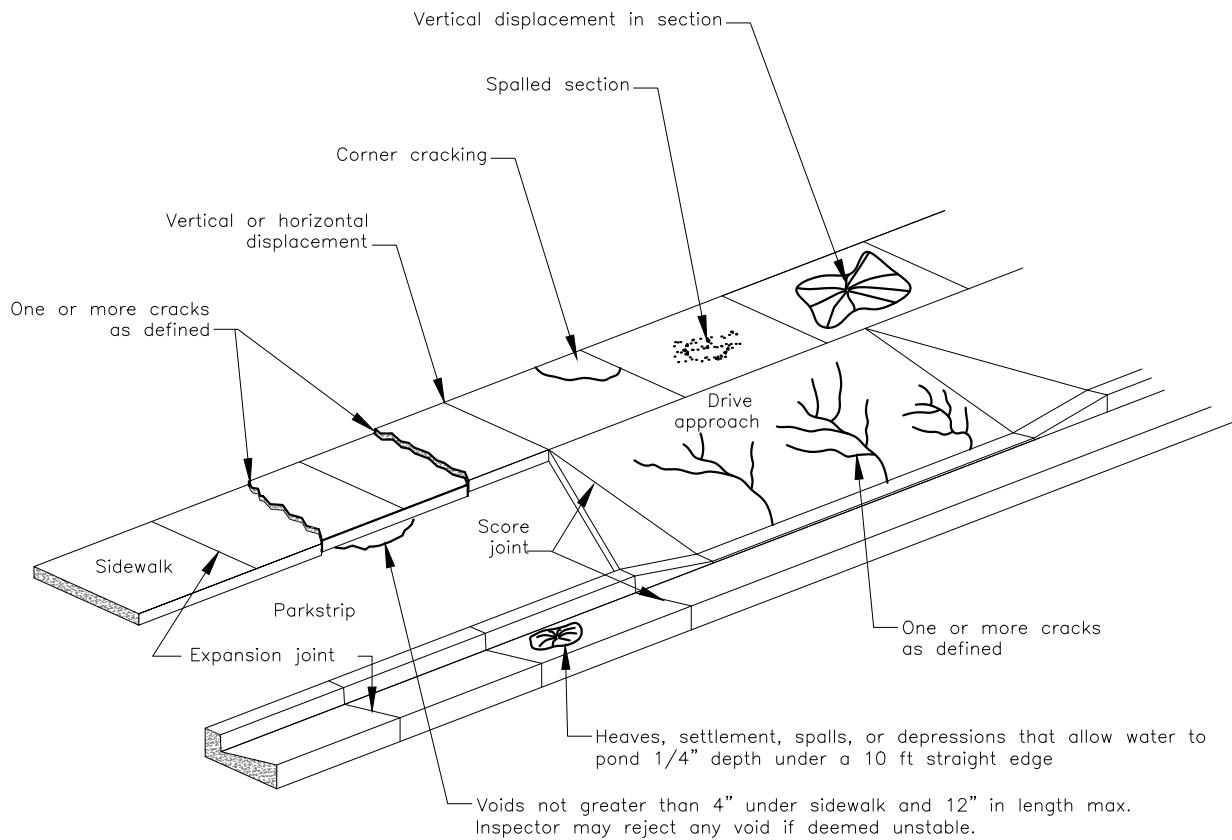

## DEFECTIVE CONCRETE


STANDARD PLAN

155

SHEET 2 OF 2

ASSEMBLY COLOR: BLACK

  
Mountain States Lighting  
609 Krista Court  
Murray, Utah 84123  
Phone 801-268-4879  
Fax 801-605-9058

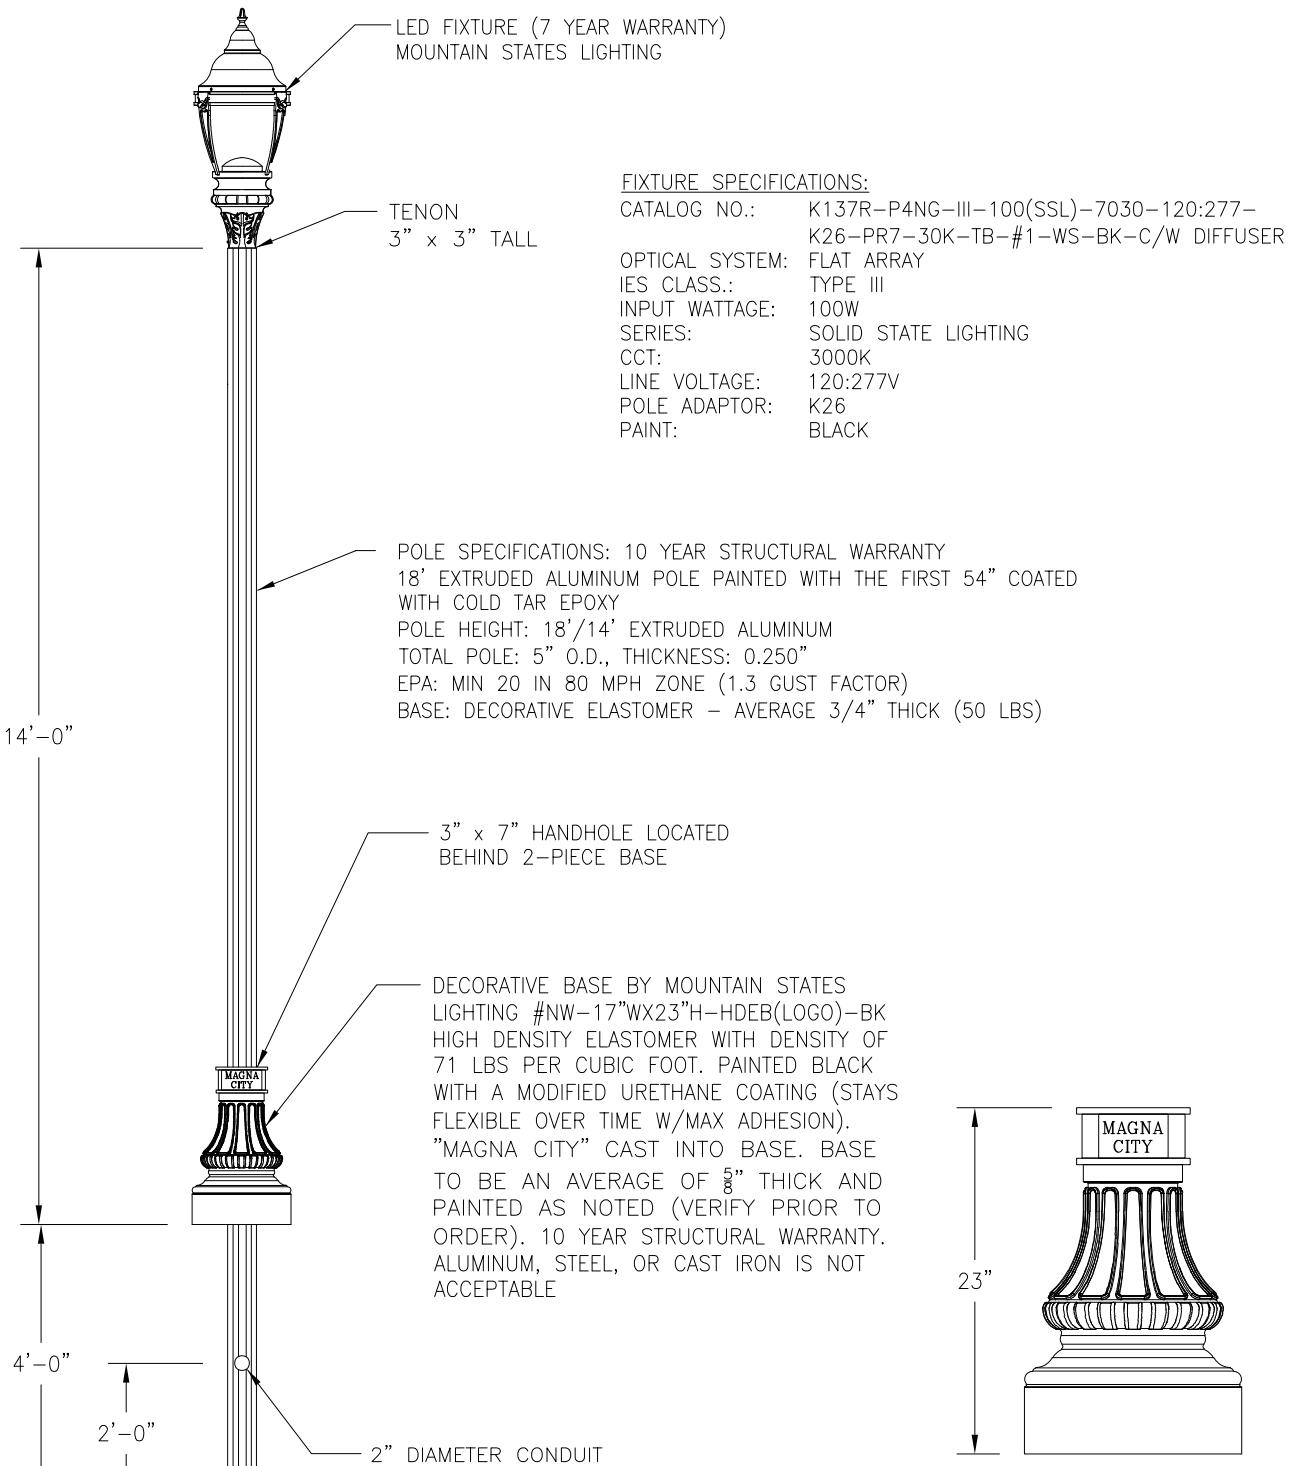

DECORATIVE BASE DETAIL




## COLLECTOR LED STREET LIGHT

STANDARD PLAN

161

SHEET 1 OF 2

24" DIA., 4" THICK CONCRETE  
BASE/MOW STRIP IF INSTALLED IN  
PARK STRIP. SEE STANDARD  
DRAWING 150 IN THIS DOCUMENT  
FOR INSTALLATION IN CONTIGUOUS  
SIDEWALK.

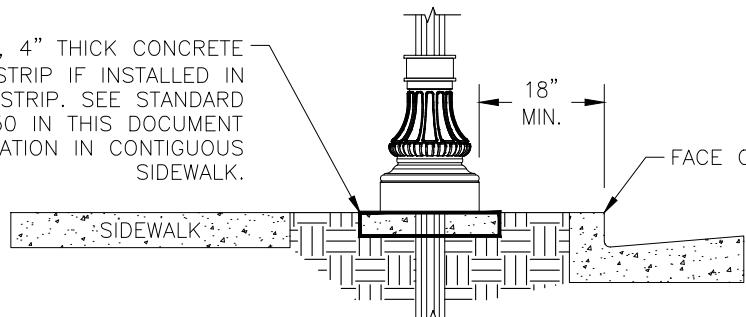

INSTALLATION DETAILS

REQUIRED FIXTURE SPACING:  
135' MAX. ON EACH SIDE OF ROAD.




COLLECTOR LED STREET LIGHT

STANDARD PLAN


161

SHEET 2 OF 2

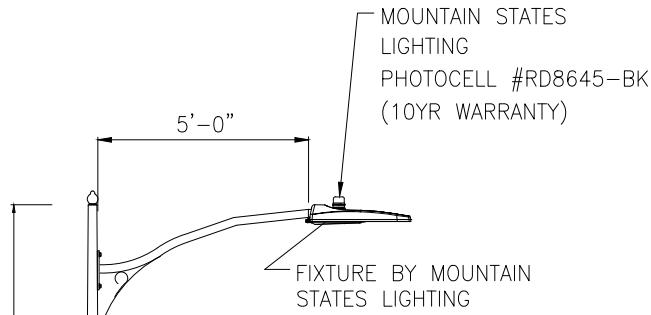


## Fixture Specifications

CATALOG NO.: CRLM-A48L200UD3M40BK10V-7RD-N  
IES CLASS.: TYPE III  
LUMENS: 20,000LM  
SERIES: SOLID STATE LIGHTING  
CCT: 4000K  
LINE VOLTAGE: 120:277V  
PAINT: BLACK

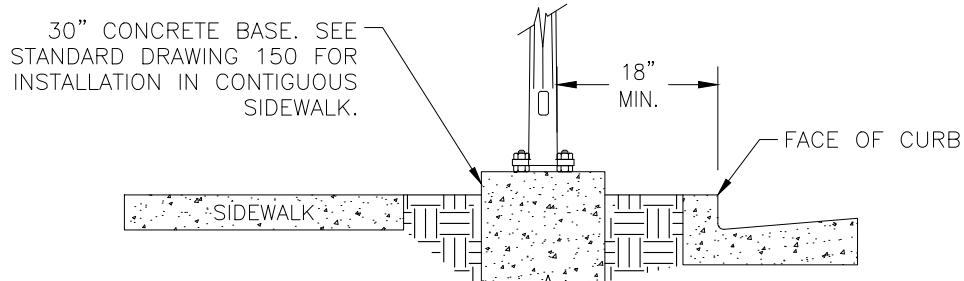


30'-0" ASSEMBLY COLOR: BLACK

POLE BY MOUNTAIN STATES LIGHTING  
P#30RTS-7/4.5-(1)ARM/60" L-BK  
30' TAPERED SMOOTH STEEL  
PAINTED BLACK  
MIN EPA OF 12 IN 80 MPH ZONE  
(1.3 GUST FACTOR)

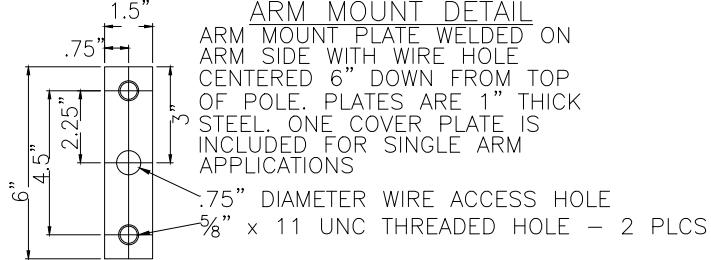

## INSTALLATION DETAILS

3" X 5" HANDHOLE WITH COVER  
BOLT COVER COLOR TO MATCH POLE



ANCHOR PLATE DETAIL  
BASE PLATE  
1" THICK x 12.0" x 12.0" (Steel)  
PLATE TEMPLATE  
4 SLOTTED HOLES (1  $\frac{1}{8}$ " x 2  $\frac{1}{4}$ ")  
90° use 12" Ø BOLT CIRCLE.  
12" Ø WIREWAY (CNTR'D.)  
ANCHOR BOLTS  
4 - 1" Ø x 36" Long w/ 4" Hook  
PROJECT 4" OUT OF CONC.




## INDUSTRIAL LED STREET LIGHT

STANDARD PLAN

162

SHEET 1 OF 2

NOTE! IF DEPTH  
CANNOT BE MET  
MASS MUST BE  
EQUIVILENT TO MASS  
SHOWN

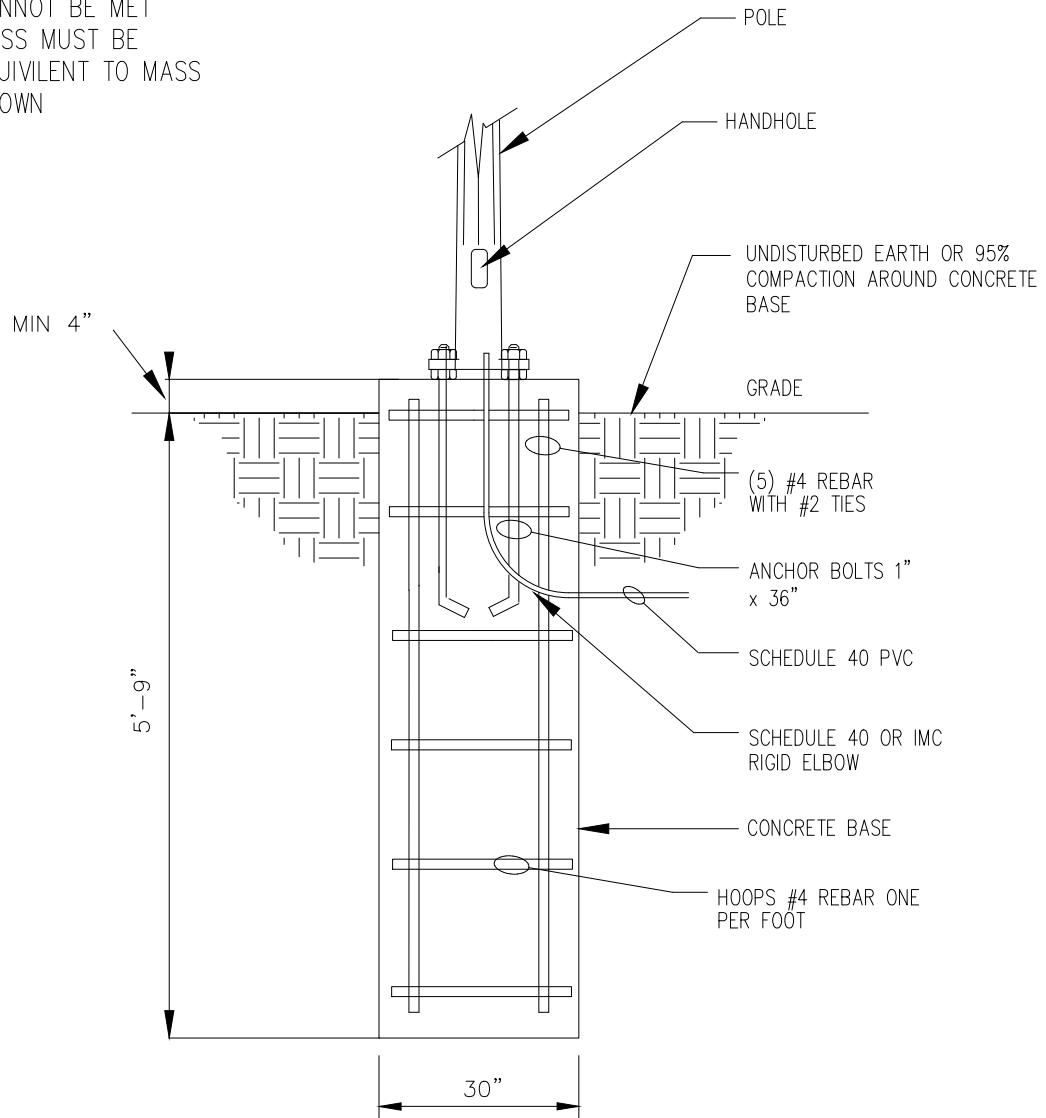

30' POLE – CONCRETE BASE DETAIL

REQUIRED FIXTURE SPACING:  
327' MAX. ON EACH SIDE OF ROAD.




INDUSTRIAL LED STREET LIGHT

STANDARD PLAN

162

SHEET 2 OF 2

ASSEMBLY COLOR: BLACK

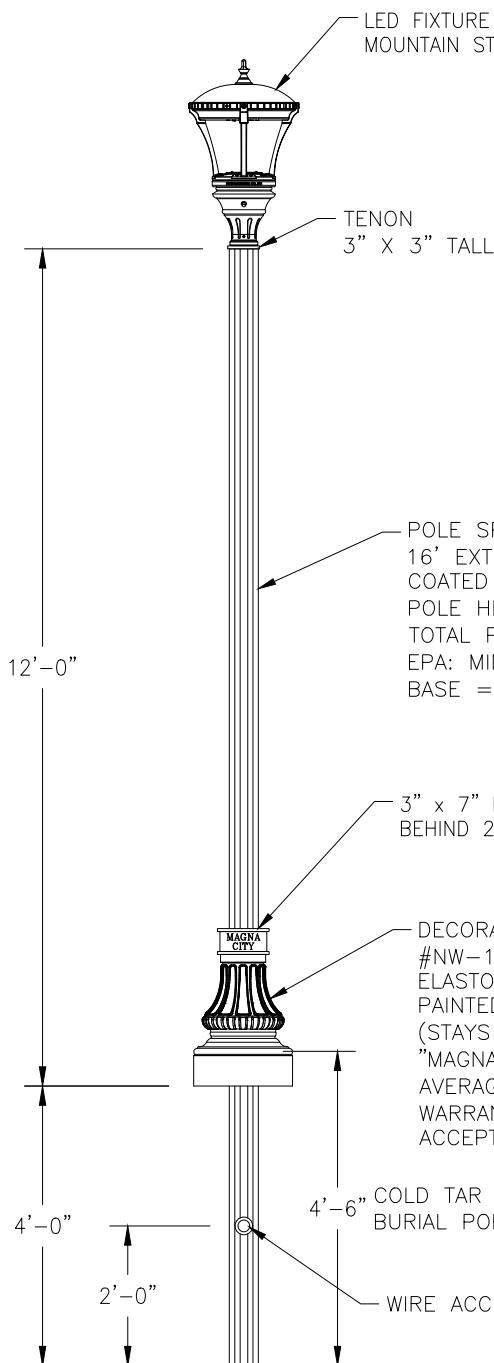

Fixture Specifications:

CATALOG NO.: K595-P4NL-III-60(SSL)-120:277-K24  
-PR7-30K-#1-BK-C/W DIFFUSER  
OPTICAL SYSTEM: FLAT ARRAY  
IES CLASS.: TYPE III  
INPUT WATTAGE: 60W  
SERIES: SOLID STATE LIGHTING  
CCT: 3000K  
LINE VOLTAGE: 120:277V  
POLE ADAPTOR: K24  
PAINT: BLACK

REQUIRED FIXTURE SPACING:  
112' MAX. ON EACH SIDE OF ROAD.

DECORATIVE BASE DETAIL




**RESIDENTIAL LED STREET LIGHT**

STANDARD PLAN

163

SHEET 1 OF 2

24" DIA., 4" THICK CONCRETE  
BASE/MOW STRIP IF INSTALLED IN  
PARK STRIP. SEE STANDARD  
DRAWING 150 IN THIS DOCUMENT  
FOR INSTALLATION IN CONTIGUOUS  
SIDEWALK.

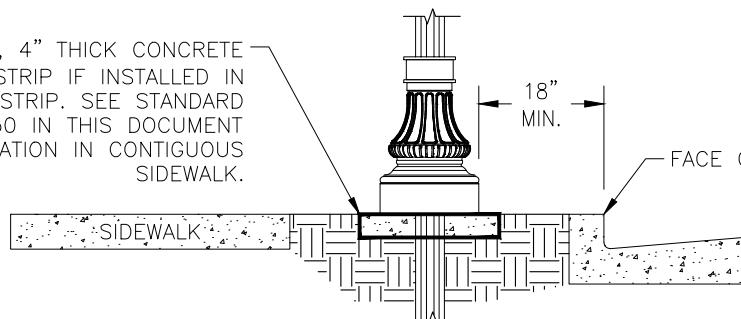

INSTALLATION DETAILS



## RESIDENTIAL LED STREET LIGHT

STANDARD PLAN

163


SHEET 2 OF 2

# Fixture Specifications

CATALOG NO.: MSL #K829-P4FL-200(SSL)-8060-120:277V-3K-BK-WS-R-STYLE-ADAPTOR-DIFFUSER  
 OPTICAL SYSTEM: FLAT ARRAY W GLOBE  
 IES CLASS.: TYPE III  
 INPUT WATTAGE: 200W  
 SERIES: SOLID STATE LIGHTING  
 CCT: 3000K  
 LINE VOLTAGE: 120:277V  
 PAINT: TEXTURED BLACK  
 TERMINAL BLOCK  
 WATTAGE SWITCH



Mountain States Lighting  
 609 Krista Court  
 Murray, Utah 84123  
 Phone 801-268-4879  
 Fax 801-605-9058

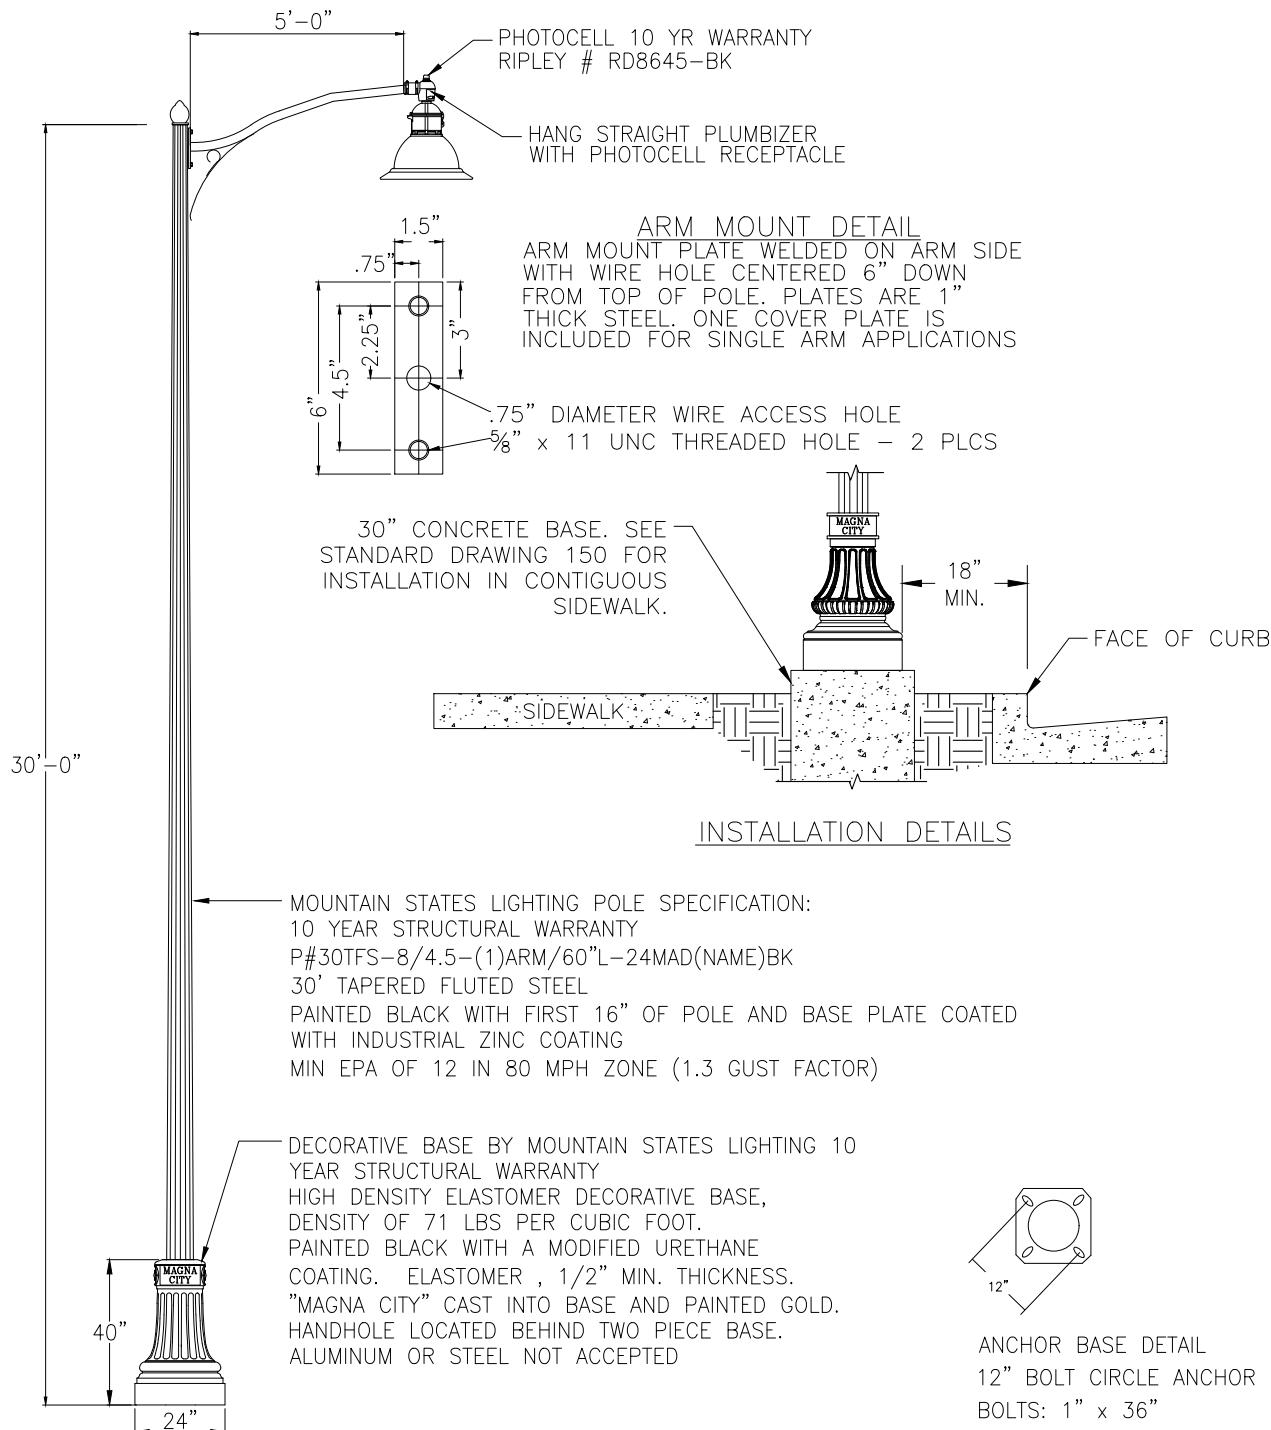

## ARTERIAL LED STREET LIGHT


STANDARD PLAN

164

SHEET 1 OF 2

REV. 2025-0

NOTE! IF DEPTH  
CANNOT BE MET  
MASS MUST BE  
EQUIVILENT TO MASS  
SHOWN

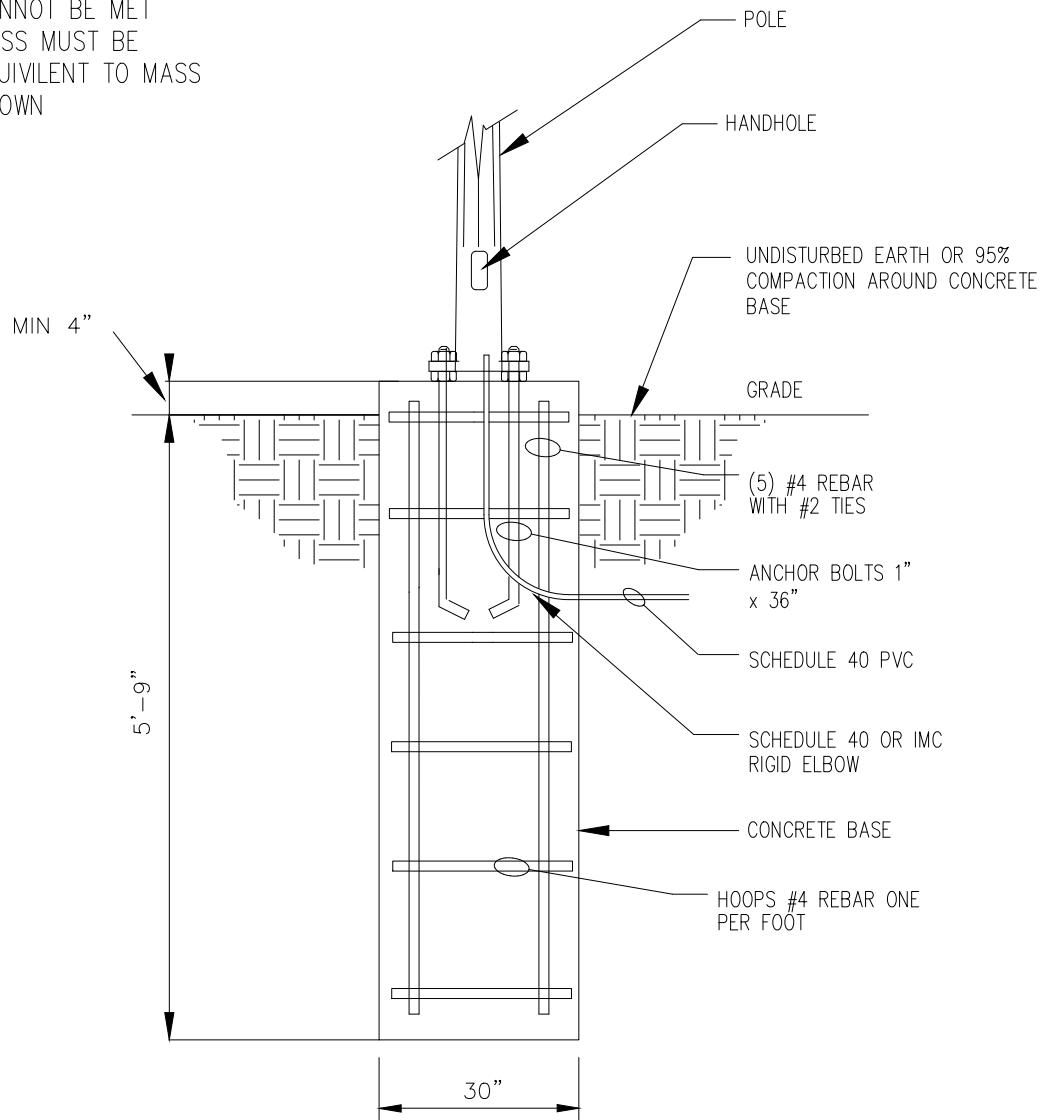

30' POLE – CONCRETE BASE DETAIL

REQUIRED FIXTURE SPACING:  
276' MAX. ON EACH SIDE OF ROAD.




ARTERIAL LED STREET LIGHT

STANDARD PLAN

164


SHEET 2 OF 2

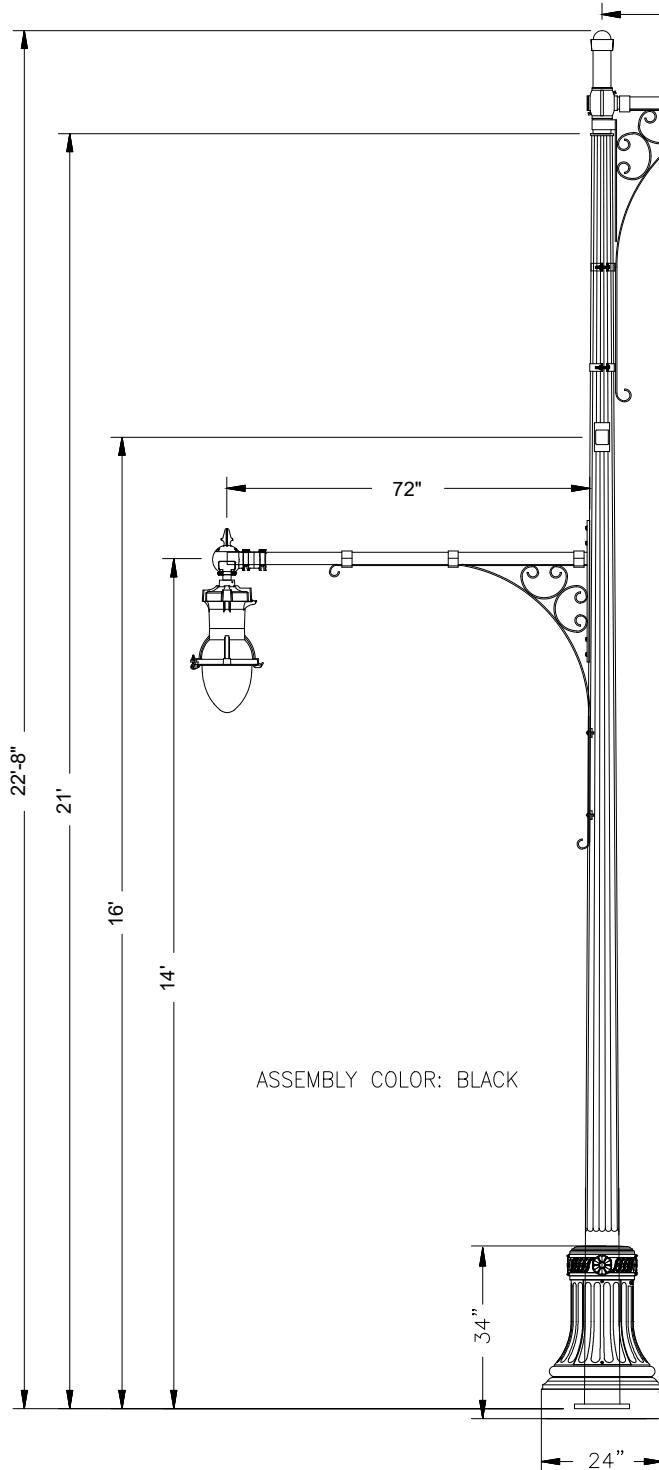

## MATERIAL SPECIFICATIONS

POLE: L210-700A21P9-MOD-SPCL/HN24-BK  
RFD196733  
UPPER ARM: CAM 72IN 1A TN CDXCDY BK –  
(2)BHDF QSM BK  
LOWER ARM: CAM 72IN 1A BO CD6CD6 BK  
RFD348288  
UPPER FIXTURE: ESL3 P25S 40K MVOLT TG4 QSM  
BK PR7 PCLL  
LOWER FIXTURE: ESPL2 P30 40K MVOLT TG4 QSM  
BK PR7 PCLL  
DECORATIVE BASE: 24" MADISON WITH TEXT "MAGNA  
CITY" CAST INTO BASE

## ANCHOR BASE DETAIL

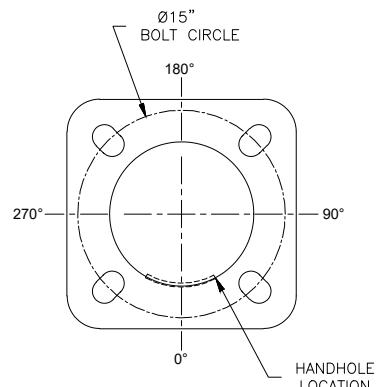

### BASE PLATE

1" THICK (Steel)

### PLATE TEMPLATE

4 SLOTTED HOLES (1  $\frac{1}{8}$ " x 2  $\frac{1}{4}$ ")  
90° use 15" Ø BOLT CIRCLE.

15" Ø WIREWAY (CNTR'D.)

### ANCHOR BOLTS

4 – 1" Ø x 36" Long w/ 4" Hook  
PROJECT 4" OUT OF CONC.




## MAGNA MAIN ST DUAL LED STREET LIGHT

STANDARD PLAN

165

SHEET 1 OF 2

30" DIA., 4" THICK CONCRETE  
BASE/MOW STRIP IF INSTALLED IN  
PARK STRIP. SEE STANDARD  
DRAWING 150 IN THIS DOCUMENT  
FOR INSTALLATION IN CONTIGUOUS  
SIDEWALK.

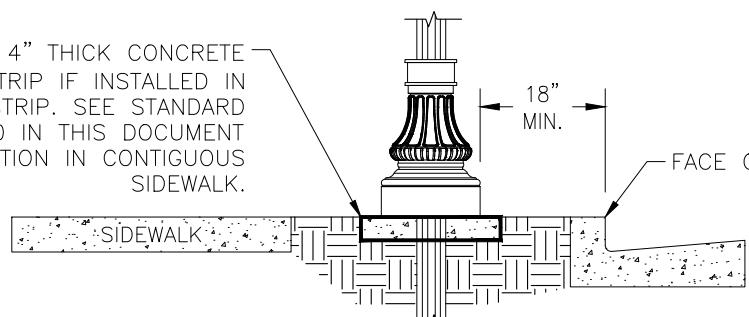

INSTALLATION DETAILS




## MAGNA MAIN ST DUAL LED STREET LIGHT

STANDARD PLAN

165

SHEET 2 OF 2

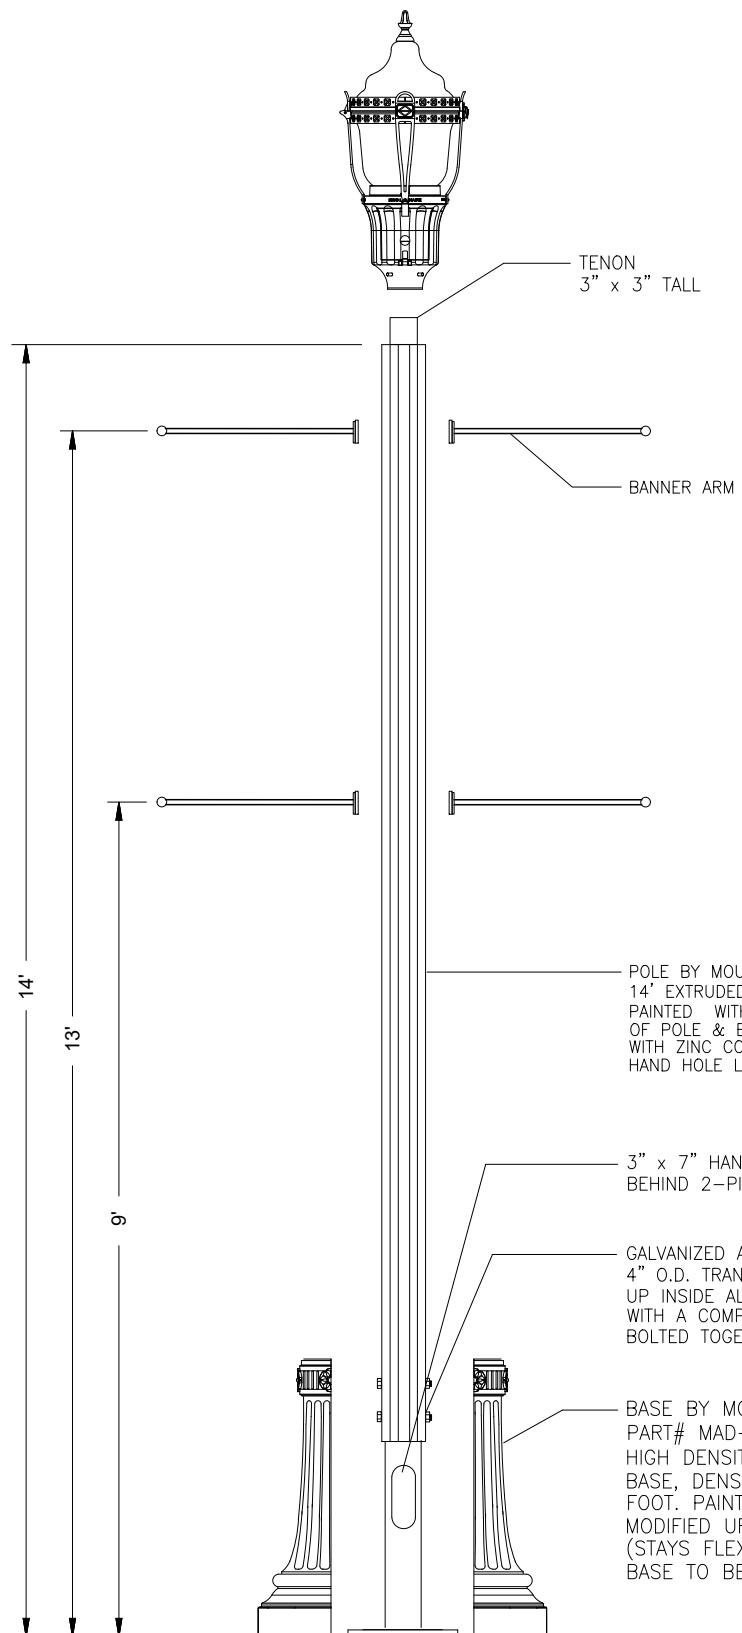


## MATERIAL SPECIFICATIONS

LIGHT FIXTURE: CATALOGUE NO. K445-EGP  
-III-70-MOG-HPS-VOLT(MT)K24-PR-SRS

POLE: 14' EXTRUDED ALUMINUM. 5" O.D. AND  
0.25" THICKNESS. MIN 20 EPA IN 80 MPH  
ZONE (1.3 GUST FACTOR)

BASE: DECORATIVE ELASTOMER WITH 3/4"  
AVERAGE THICKNESS (50 LBS)


ANCHOR PLATE: 12" BOLT CIRCLE WITH 3/4" X  
18" BOLTS



ANCHOR BASE DETAIL  
12" BOLT CIRCLE  
ANCHOR BOLTS: 3/4" x 18"



24" DIA., 4" THICK CONCRETE  
BASE/MOW STRIP IF INSTALLED IN  
PARK STRIP. SEE STANDARD  
DRAWING 150 IN THIS DOCUMENT  
FOR INSTALLATION IN CONTIGUOUS  
SIDEWALK.

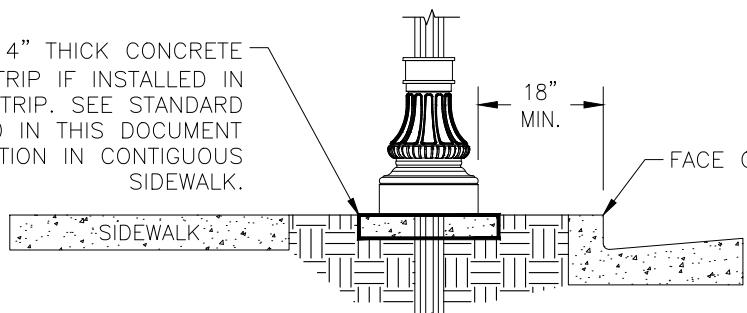

INSTALLATION DETAILS




## MAGNA MAIN ST SINGLE LED STREET LIGHT WITH BANNER ARMS

STANDARD PLAN

166

SHEET 2 OF 2

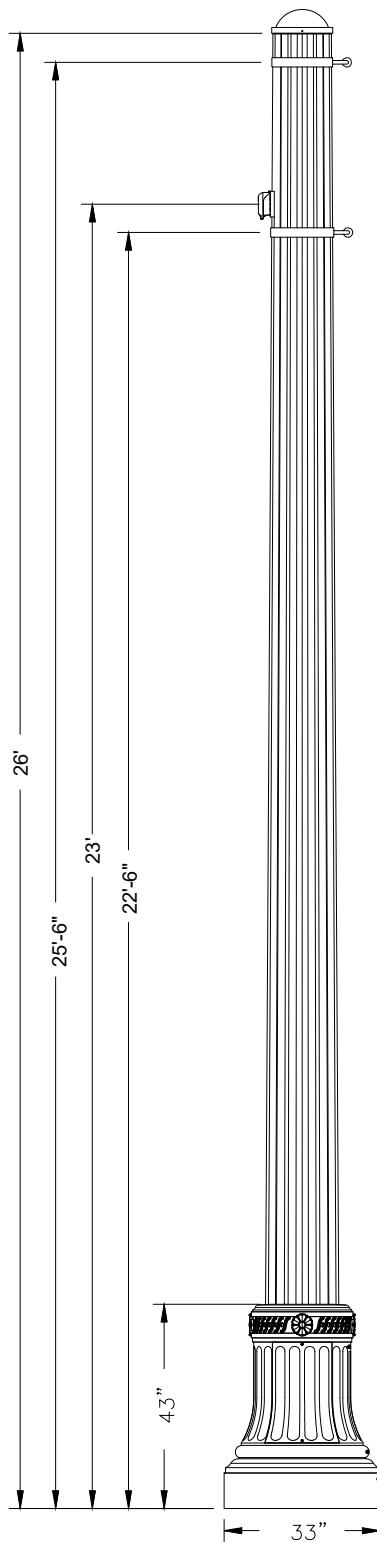


## MATERIAL SPECIFICATIONS

POLE: FLS-S001260-FEST-EB-BK

DECORATIVE BASE: HNSSAB-BK

STAINLESS STEEL EYEBOLTS FOR HOLDING A BANNER TO BE SET AT THE SAME ORIENTATION OF THE POLE AT HEIGHTS OF 22'-6" AND 25'-6". GFI RECEPTACLE WITH COVER TO BE SET AT THE OPPOSITE ORIENTATION AT A HEIGHT OF 23'-0".

FOUR HOT DIP GALVANIZED L-TYPE ANCHOR BOLTS TO BE INSTALLED ON A  $\varnothing 22"$  BOLT CIRCLE.

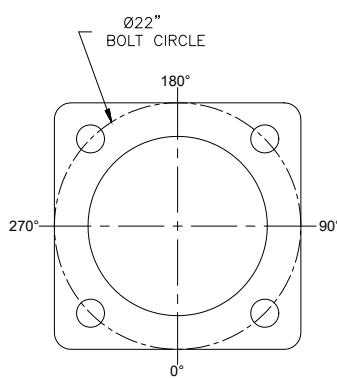

ANCHOR BASE DETAIL




MAGNA MAIN ST BANNER POLE

STANDARD PLAN

167

SHEET 1 OF 2

36" DIA., 4" THICK CONCRETE  
BASE/MOW STRIP IF INSTALLED IN  
PARK STRIP. SEE STANDARD  
DRAWING 150 IN THIS DOCUMENT  
FOR INSTALLATION IN CONTIGUOUS  
SIDEWALK.

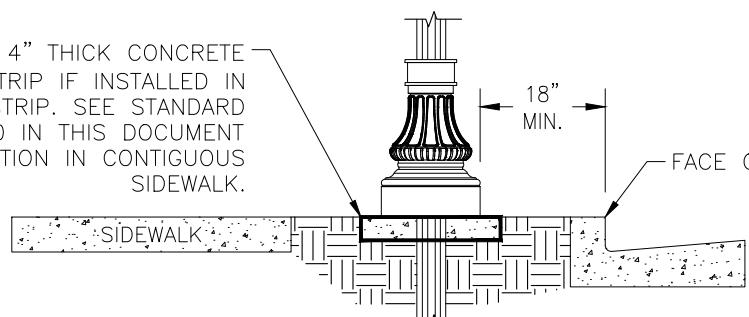

INSTALLATION DETAILS



## MAGNA MAIN ST BANNER POLE

STANDARD PLAN

167

SHEET 2 OF 2

## NOTES:

Materials, construction, and workmanship shall be in accordance with the current edition of "APWA Manual of Standard Specifications" addendums, and modifications thereto; and as directed by the MSD Engineer.

Cast Iron to conform to ASTM A-48, Class 35B H-20 wheel loading.

Use D&L Supply Co. I-3517 or approved equivalent.

All connecting hardware to be stainless steel.




## CURB OPENING FRAME AND GRATE


STANDARD PLAN

201


SHEET 1 OF 2

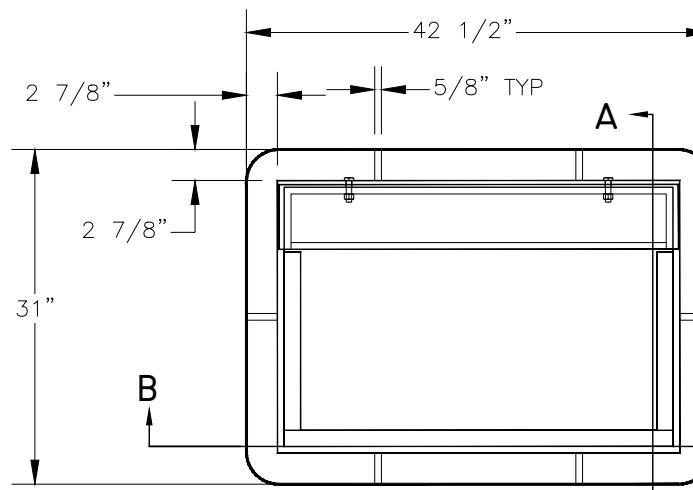

FRAME PLAN

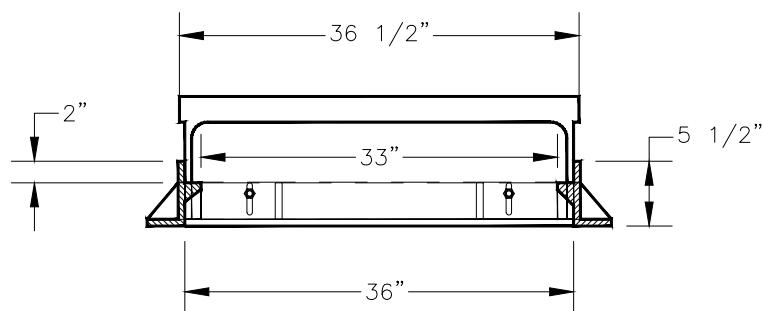


SECTION B-B

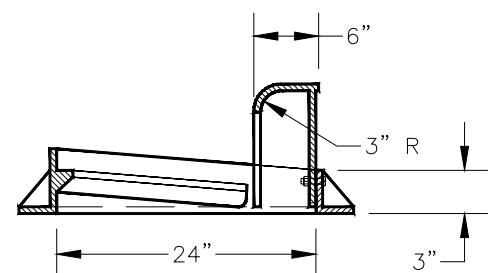


SECTION A-A


FLOW DIRECTION

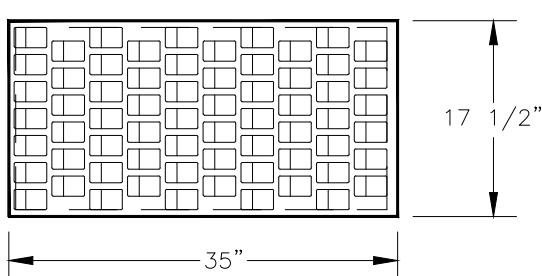

GRATE PLAN

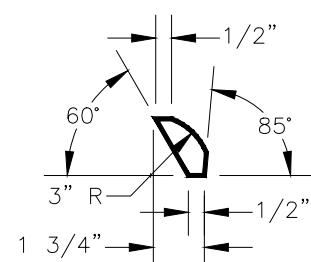

DETAIL

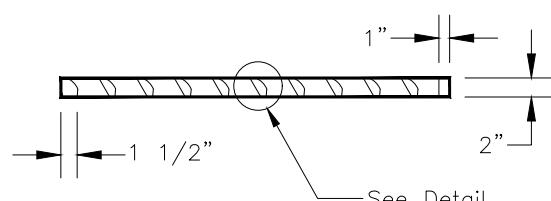

CURB OPENING FRAME AND GRATE

STANDARD PLAN

201

SHEET 2 OF 2

## NOTES:

Materials, construction, and workmanship shall be in accordance with the current edition of "APWA Manual of Standard Specifications" addendums, and modifications thereto; and as directed by the MSD Engineer.

Ladder Rungs: Provide rungs in boxes over 4 feet deep, spaced 12" O.C. When measured from the floor of the box, place bottom rung 16" maximum above box floor. Place top rung within 3 feet of finish grade.

Follow all current OSHA requirements.

Align rungs with lid opening.

Rungs not required in boxes with concentric access.

Ladder rungs shall be copolymer polypropylene plastic coating over a  $\frac{1}{2}$  inch steel bar.

Steel bar shall conform to ASTM 615 Grade 60.

Use M.A. Industries PS1-PF 10" Manhole Single Face Step or approved product with similar materials and ratings with MSD Engineer approval.




## LADDER RUNG



STANDARD PLAN

208


SHEET 1 OF 2

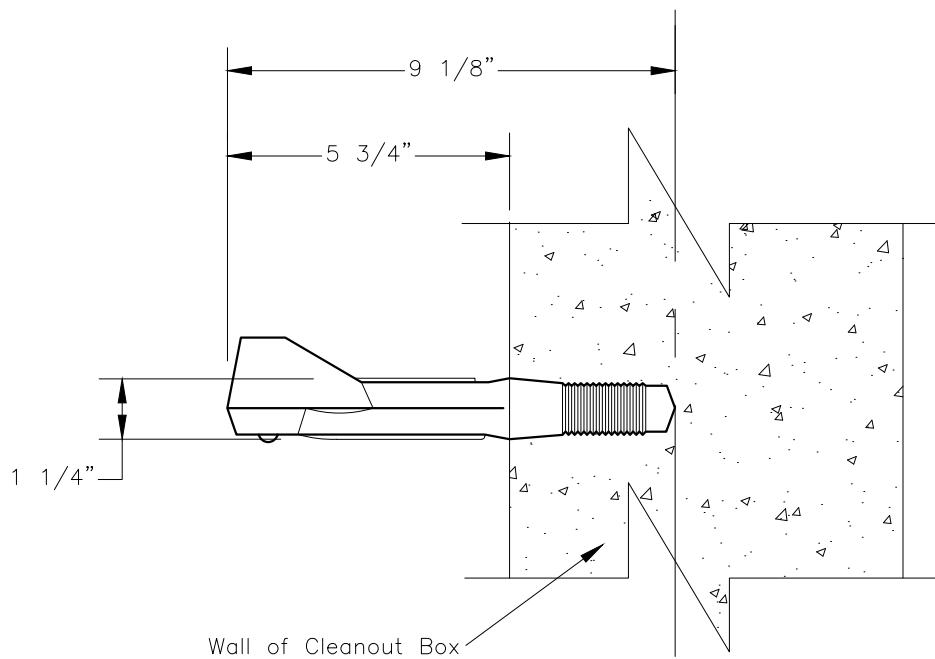

SECTION

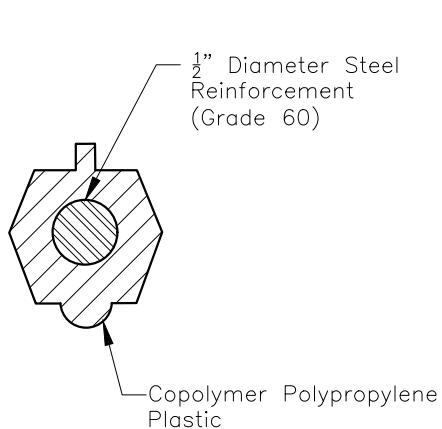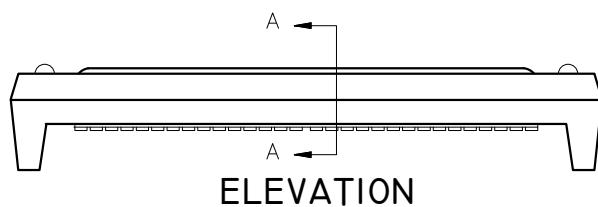

SECTION A-A

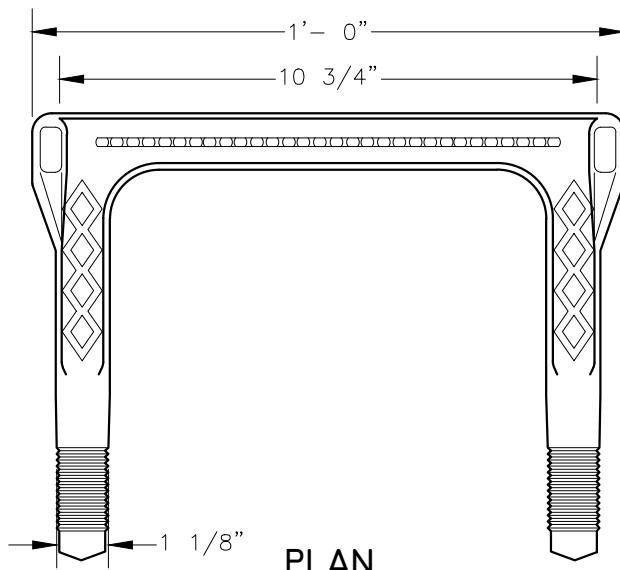

LADDER RUNG

STANDARD PLAN

208

SHEET 2 OF 2

## NOTES:

### GENERAL DETENTION BASIN REQUIREMENTS:

- ① Side slopes shall be a maximum of 3:1.
- ② Sides and bottom of basin shall be rock lined. In special circumstances such as when the basin contains a park or playing field, the basin may be lined with grass, with approval of the MSD Engineer. For rock lining, use 2" rock with a minimum depth of 5" over separation fabric. If grass lined, the area must be adequately irrigated with a permanent pressurized irrigation system.
- ③ 1 foot of freeboard above the 10-year 24-hour storm event level or capacity for the 100-year 24-hour storm.
- ④ Concrete low flow pipe or channel preferred.

### SECTION A. INLET AND OUTLET STRUCTURE REQUIREMENTS:

- ⑤ Outflow must be restricted per the code requirements.
- ⑥ Must include a concrete flared end section and locking grate, unless underground low-flow conveyance is utilized.
- ⑦ Pre-treatment required prior to outflow to approved facility, outlet structure must conform to Standard Detail 301 in this document or approved outlet structure.

### SECTION B. REQUIREMENTS FOR ACCESSES TO ALL INLET/OUTLET STRUCTURES:

- ⑧ Must fall within the area of the arc (shown in the Accessible Road/Pad Detail), which is representative of the maintenance vehicles' reach.
- ⑨ No increase in elevation greater than 5' from surface of accessible road or pad.
- ⑩ No decrease in elevation greater than 35' from surface of accessible road or pad.
- ⑪ Must be a minimum of 45 feet in length from traveled way of connecting roadway if a detention pond specific access road or pad is utilized.

### SECTION C. ACCESSIBLE ROAD/PAD REQUIREMENTS:

- ⑫ Must be easily accessible by maintenance vehicles.
- ⑬ Must not exceed a maximum longitudinal slope of 12%.
- ⑭ Must be at least 10' in width.
- ⑮ No cross-slope in excess of 2%.
- ⑯ Must be a minimum of 6" thick concrete.
- ⑰ Must have measures in place restricting public access (ex. bollards). If bollards are used, must be of stainless steel material.
- ⑱ Must comply with all other local, county, state, and federal requirements.





## DETENTION BASIN GUIDELINES


STANDARD PLAN

300

SHEET 1 OF 2

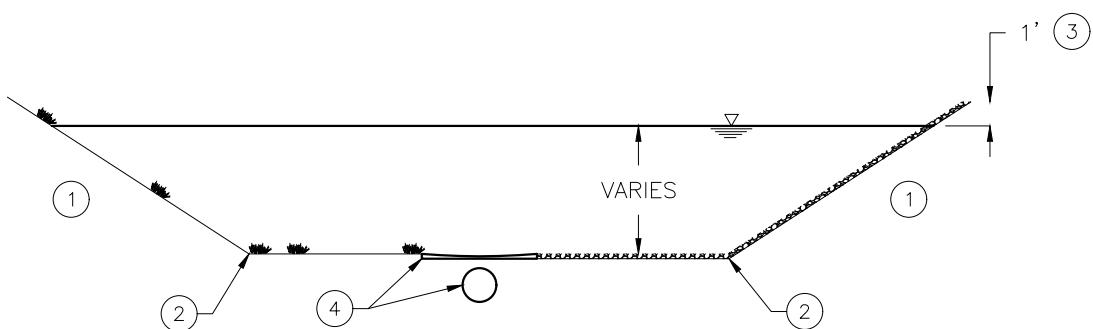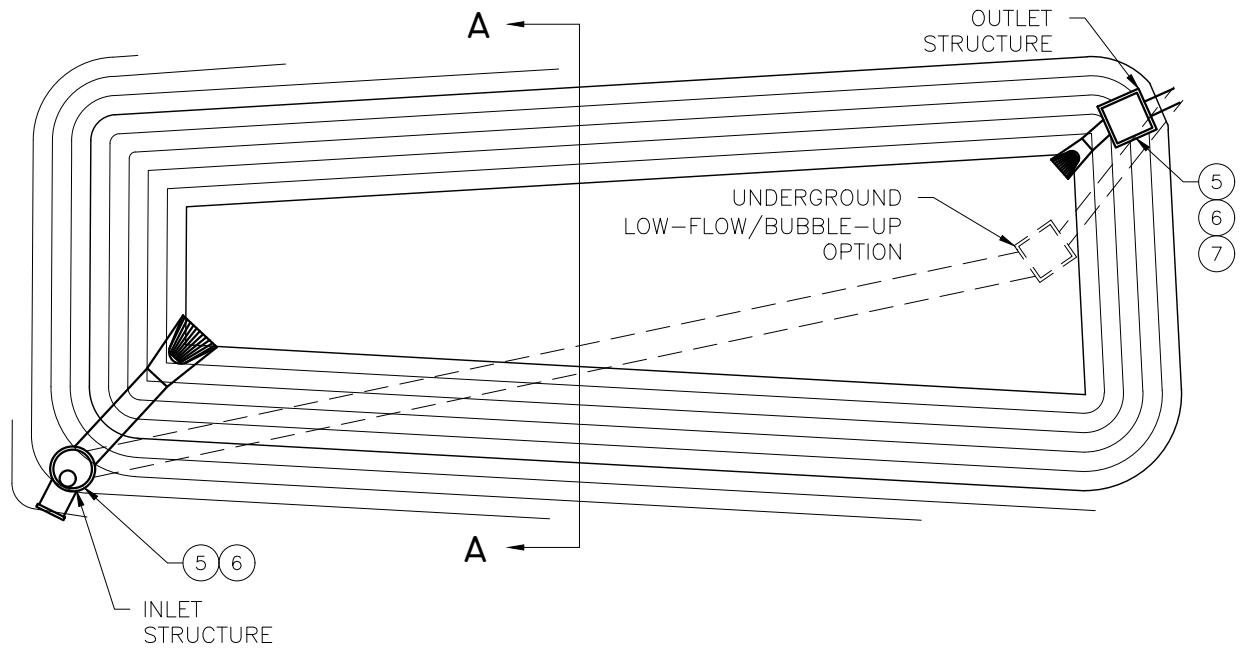

SECTION A-A - TYPICAL BASIN SECTION

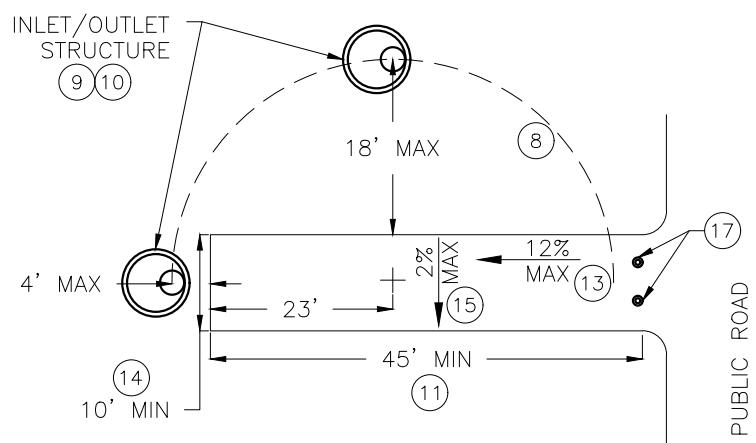

TYPICAL COUNTY ACCESSIBLE ROAD/PAD DETAIL



DETENTION BASIN GUIDELINES

STANDARD PLAN

300

SHEET 2 OF 2

## NOTES:

Materials, construction, and workmanship shall be in accordance with the current edition of "APWA Manual of Standard Specifications" addendums, and modifications thereto; and as directed by the MSD Engineer. Reference to specific sections of APWA does not limit requirements to that section.

1. Developer shall install lock and chain on handwheel. Lock to be supplied by SLCO Operations Department.
2. Provide gate with stop nut on stem to hold gate at 10" above invert of orifice or higher.
3. Golden Harvest slide gate with non-rising stem and handwheel, or approved equal. Cut grate as required for extension of frame.
4. The drawing on Sheet 2 is intended to be general in nature, but shows the overall conceptual requirements for the outlet structure, including box with weir wall, orifice, gate, hood, and grated top. The specific size of the components shall be designed for the specific application.




## OUTLET STRUCTURE GUIDELINES


STANDARD PLAN

301

SHEET 1 OF 2

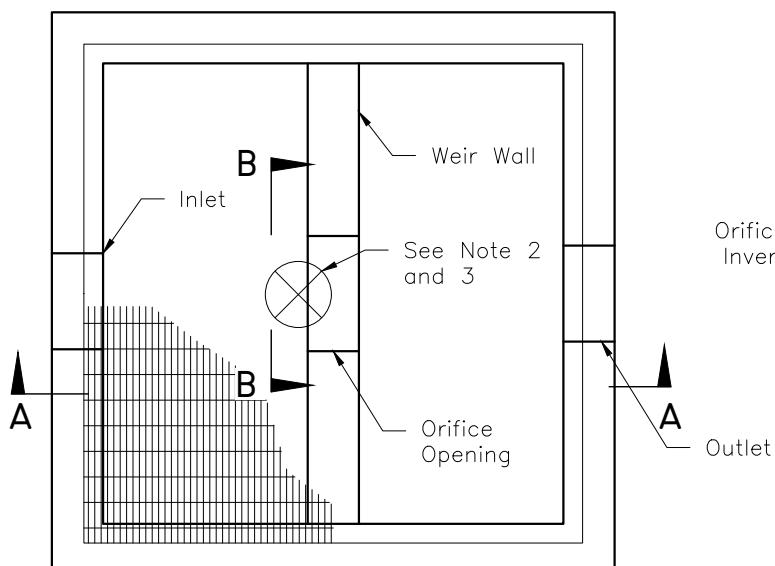

PLAN

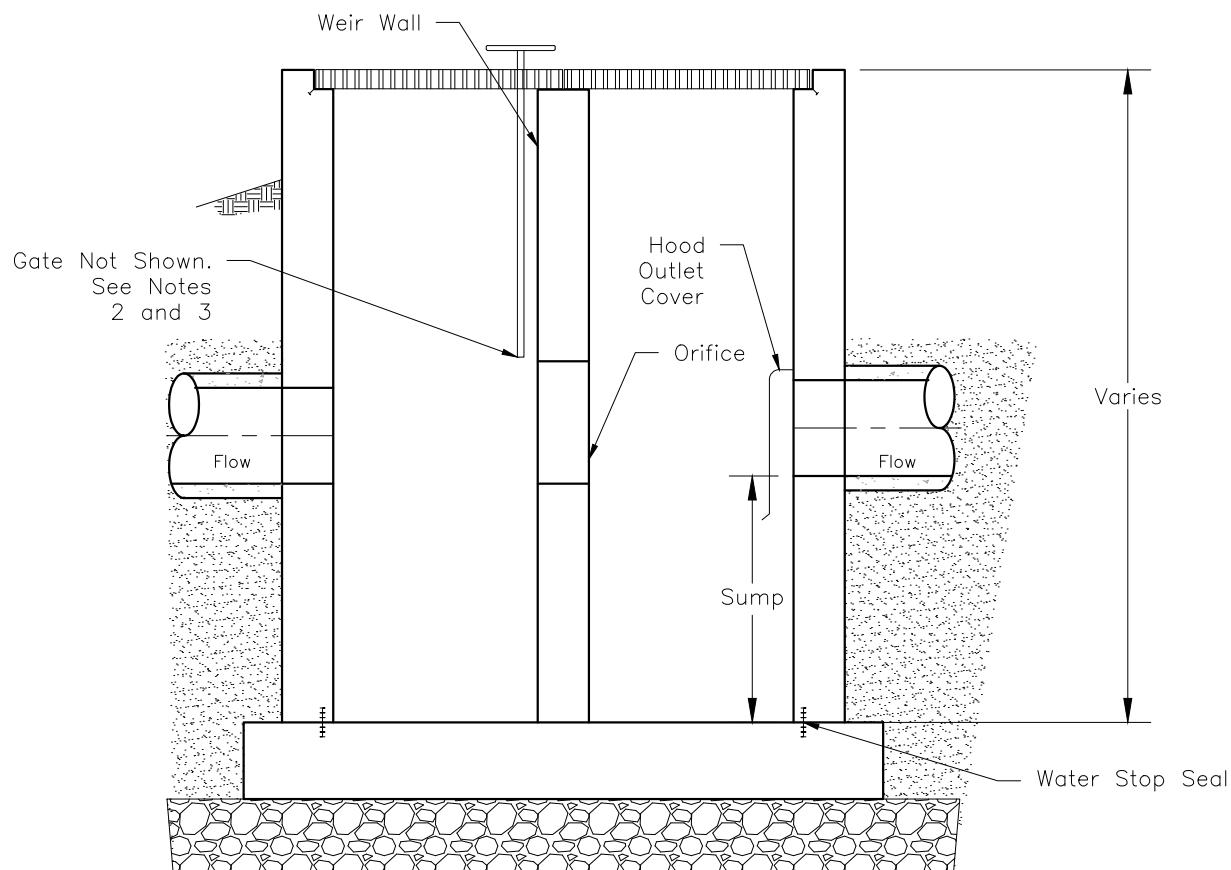

SECTION A



## OUTLET STRUCTURE GUIDELINES

STANDARD PLAN

301

SHEET 2 OF 2



# ENGINEERING STANDARDS & DRAWINGS



G R E A T E R   S A L T   L A K E

**Municipal Services  
District**

860 W Levoy Drive, Suite #300  
Taylorsville, UT 84123  
**(385) 910-7027**  
**[msd.utah.gov/engineering](http://msd.utah.gov/engineering)**